
Choose your PowerDrop

Single-phase equipment supplied from one phase and neutral on T225 busway.

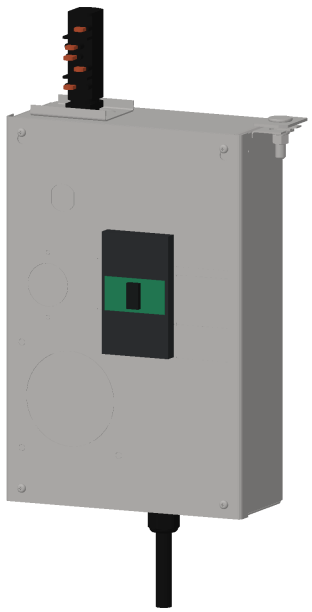

Breakered power where the equipment needs it.
Choose branch amperage, matching equipment connection and outlet arrangement. Then complete the applicable ordering details.

15A/20A/30A
NEMA connections at the supported ratings shown on page 2.

50A / 60A / 100A
IEC Pin & Sleeve. Each higher-amperage build has one output. A 50A IEC build uses a 60A-rated device protected by a 50A breaker.

Representative compact enclosure. Cord continues to the selected female connector; length and termination depend on the build.

Equipment supply	Busway supply
120V line-to-neutral	208Y/120V
240V line-to-neutral	415Y/240V (nominal)
277V line-to-neutral	480Y/277V

Choose the outlet arrangement

Arrangement	Protection and selection
One connector cord	One 1-pole circuit breaker; enclosure follows the selected base.
Multiple outputs	Up to 3 outputs only where listed on page 2. Each branch output has its own 1-pole breaker.
Duplex / quad	20A, 120V 5-20R assembly; two or four receptacle positions share one 1-pole branch circuit.

Download the selected cut sheet after choosing the arrangement. Phase and orientation are not required for that base download. Complete ordering details for a configured sheet.

Build your 1-pole PowerDrop

trackbusway.com/products/225a-1-pole-breakered-drop-cord

Choose the connection

Click a blue catalogue number to open that build. Numbers shown: one output, standard ground, no monitoring. Supported alternatives appear at right.

Breaker / supply	Connection & base catalogue number	Outputs	Grounding / GFCI
15A / 120V L-N	**L5-15C** PT225-C-10-DCXX-L515C-G	1/2/3	Standard / IG
15A / 277V L-N	**L7-15C** PT225-C-10-DCXX-L715C-G	1/2/3	Standard
20A / 120V L-N	**5-20C** PT225-C-10-DCXX-520C-G	1	Standard / IG
20A / 120V L-N	**5-20R duplex** PT225-C-10-DCXX-520D-G	1	Standard / IG; GFCI*
20A / 120V L-N	**5-20R quad** PT225-C-10-DCXX-520Q-G	1	Standard / IG; GFCI*
20A / 120V L-N	**L5-20C** PT225-C-10-DCXX-L520C-G	1/2/3	Standard / IG
20A / 240V L-N	**L7-20C** PT225-C-10-DCXX-L720C-240LN-1P-G	1/2/3	Standard
20A / 277V L-N	**L7-20C** PT225-C-10-DCXX-L720C-G	1/2/3	Standard
30A / 120V L-N	**L5-30C** PT225-C-10-DCXX-L530C-G	1/2/3	Standard / IG
30A / 240V L-N	**L7-30C** PT225-C-10-DCXX-L730C-240LN-1P-G	1/2/3	Standard
30A / 277V L-N	**L7-30C** PT225-C-10-DCXX-L730C-G	1/2/3	Standard
50A / 120V L-N	**360C4W** PT225-C-10-DCXX-360C4W-CB50-G	1	Standard
60A / 120V L-N	**360C4W** PT225-C-10-DCXX-360C4W-G	1	Standard
100A / 120V L-N	**3100C4W** PT225-C-10-DCXX-3100C4W-CB100-G	1	Standard

***GFCI:** standard ground only; never combined with IG. Duplex/quad output count is one assembly. **240V L-N:** 20A Leviton 2333 / plug 2331 / BGL16020; 30A 2633 / plug 2631 / BGL16030. Use the matching L7 plug; the 277V device rating does not change supplied 240V.

IEC matching plugs: 50A/60A HBL360P4W (60A, 125V, 4h); 100A HBL3100P4W (100A, 125V, 4h). The 50A and 100A builds use BGL16050 and BGL16100 breakers, respectively.

Catalogue bases exclude phase and factory orientation. The full fixed base is retained. DCXX is completed with your specified cord length in feet. IG = isolated ground; use only listed combinations.

Compare NEMA & IEC connections
trackbusway.com/products/225a-1-pole-breakered-drop-cord

Read the catalogue number

The selected base supplies the fixed codes. Complete only the applicable order selections.

Example: 30A, 120V L-N, one L5-30C

PT225-C-10-DC08-L530C-G — Base configuration + specified 8 ft cord

-L2 — Phase

-R — Orientation

Code / field	Meaning
PT225	T225 tap-off product prefix.
C-10 / S-10	Compact / standard enclosure designation. Retain the enclosure assigned to the selected configuration.
DCXX / DC08	Drop-cord length: XX = length to be specified. Replace XX with the ordered length in feet; for example, 08 = 8 ft. Applies to every PowerDrop rating.
L530C	One-pole branch connection from one selected line plus neutral. C identifies a cord connector; R within a device code identifies a mounted receptacle.
IG / GFCI	IG precedes the applicable device code. Retain GFCI where present; it is not combined with IG.
240LN-1P / CB50 / CB100	Retain these fixed identifiers when present. CB50 / CB100 distinguish the breaker rating from the output device rating.
L2 / final R	Choose the phase L1, L2 or L3. Final -T or -R is the separately chosen factory breaker orientation.

Retain the complete fixed base, including its terminal **-G** and any other existing characters. Grounding follows the selected build and applicable **IG** prefix. All examples show deliberate selections, not defaults.

Multiple outputs retain multiple device tokens

PT225-S-10-DC08-L530C-L530C-G-L1L2-T

Two outputs, each with its own breaker; typical factory orientation. Fill PHASE in output order: L1L2 means output 1 uses L1 + N and output 2 uses L2 + N. Three outputs on L1, L2 and L3 use L1L2L3. Omit N from the code.

50A example retains the explicit breaker rating

PT225-C-10-DCXX-360C4W-CB50-G-L2-T

One 60A-rated IEC output protected by a 50A, 1-pole breaker. Specify cord length with the order. The output-device rating does not increase the branch rating.


Complete the ordering details

Use these choices in the builder, then download the completed configuration sheet.

Grounding. Choose standard or isolated ground only where offered on page 2. Coordinate with the compatible busway grounding arrangement. GFCI is offered on listed 20A duplex/quad builds with standard ground only.

Power monitoring. Use **Request Power Monitoring** to carry the current configuration into a request. Existing monitored offerings remain request-only at documented ratings; new 50A/100A additions do not include monitoring. Explore critical power monitoring.

Phase connection

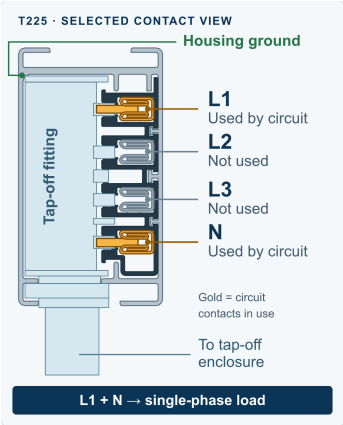


One branch circuit shown


Assign L1, L2 or L3 plus neutral to each independent circuit.
Each separate cord or receptacle assembly has its own 1-pole breaker. A typical triple arrangement is circuit 1: L1-N, circuit 2: L2-N and circuit 3: L3-N. Each output remains single-phase.

Record circuit assignments individually; examples are not preset selections. Duplex/quad assemblies retain their documented shared-branch construction. Confirm the allocation and total connected load with the factory.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

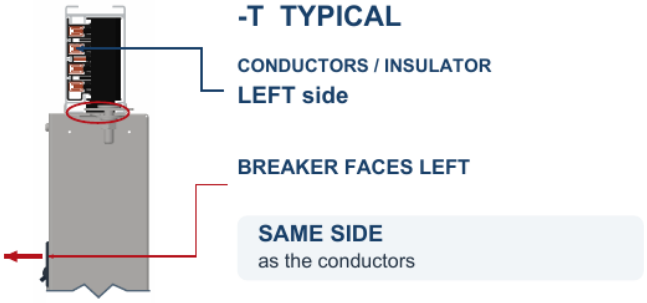

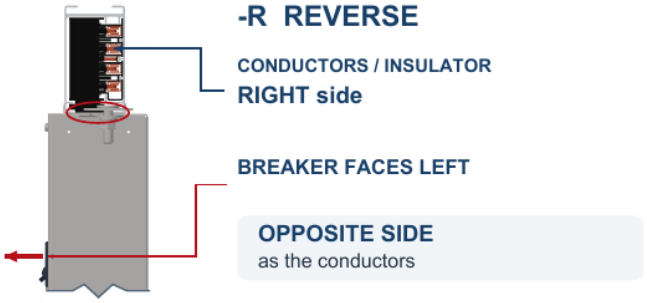

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

Cord length. Specify the required cord length for every PowerDrop. Replace XX in DCXX with the length in feet (for example, DC08 = 8 ft). Cord length excludes the enclosure. Confirm final length and price with your order.

Before ordering: confirm supply, branch rating, matching plug, arrangement, grounding, monitoring and applicable phase/orientation choices. **Factory-set. Not field-rotatable.** Specify required assembly SCCR; a component interrupting rating does not establish assembly SCCR. The factory unit label governs.

Build your 1-pole PowerDrop

trackbusway.com/products/225a-1-pole-breakered-drop-cord

USA TrackBusway™ 15A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / 1 x L5-15C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-L515C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION



Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 15A, 1-pole breaker
B Output	1 x L5-15C cord-end connector
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-15C

15A, 125V AC device rating
Equipment ground included
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-L515C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-L515C-G-L2-T
Reverse: PT225-C-10-DCXX-L515C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 15A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / 1 x L5-15C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-IGL515C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION



Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 15A, 1-pole breaker
B Output	1 x L5-15C cord-end connector
Grounding	Isolated ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-15C

15A, 125V AC device rating
Isolated equipment ground
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-IGL515C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-IGL515C-G-L2-T
Reverse: PT225-C-10-DCXX-IGL515C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 15A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 2 x 1-pole / 2 x L5-15C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L515C-L515C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

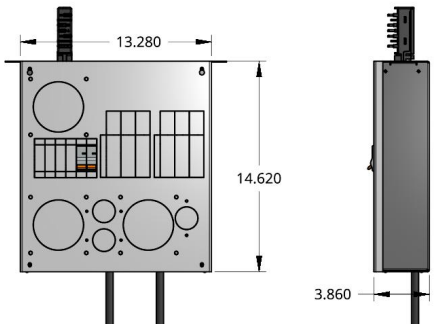

Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	2 x 15A, 1-pole breakers; one per output
B Output	2 x L5-15C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-15C

15A, 125V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 15A, 1-pole breaker per output.


Cord 1	Cord 2
15A / 1-pole breaker	15A / 1-pole breaker
L1 + N	**L2 + N**

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L515C-L515C-G-L1L2-T
Reverse: PT225-S-10-DCXX-L515C-L515C-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 15A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 2 x 1-pole / 2 x L5-15C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-IGL515C-IGL515C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

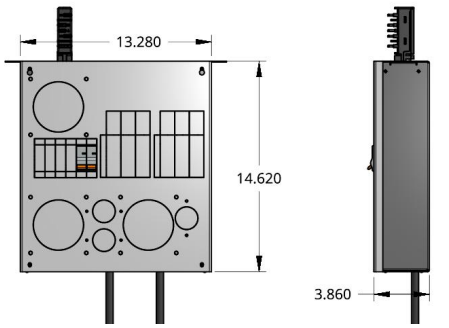

Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	2 x 15A, 1-pole breakers; one per output
B Output	2 x L5-15C cord-end connectors
Grounding	Isolated ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-15C

15A, 125V AC device rating
Isolated equipment ground
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 15A, 1-pole breaker per output.


Cord 1	Cord 2
15A / 1-pole breaker	15A / 1-pole breaker
L1 + N	**L2 + N**

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-IGL515C-IGL515C-G-L1L2-T
Reverse: PT225-S-10-DCXX-IGL515C-IGL515C-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 15A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 3 x 1-pole / 3 x L5-15C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L515C-L515C-L515C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

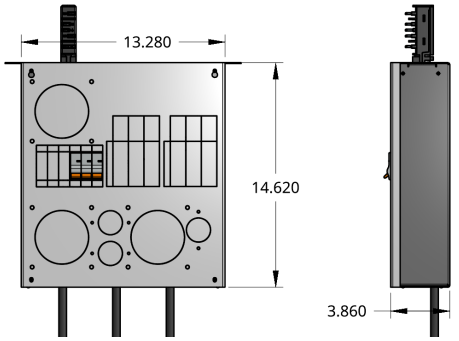

Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	3 x 15A, 1-pole breakers; one per output
B Output	3 x L5-15C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-15C

15A, 125V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 15A, 1-pole breaker per output.


Cord 1	Cord 2	Cord 3
15A / 1-pole breaker	15A / 1-pole breaker	15A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**

[PHASE] = L1L2L3 (shown)
Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L515C-L515C-L515C-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-L515C-L515C-L515C-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 15A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 3 x 1-pole / 3 x L5-15C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-IGL515C-IGL515C-IGL515C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

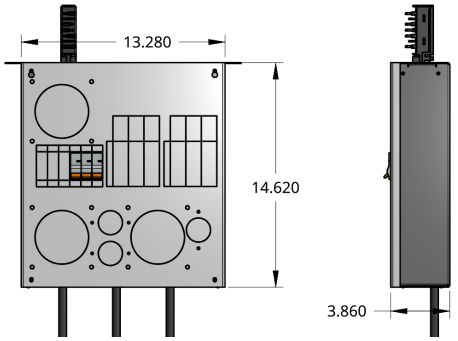

Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	3 x 15A, 1-pole breakers; one per output
B Output	3 x L5-15C cord-end connectors
Grounding	Isolated ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-15C

15A, 125V AC device rating
Isolated equipment ground
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 15A, 1-pole breaker per output.

Cord 1	Cord 2	Cord 3
15A / 1-pole breaker	15A / 1-pole breaker	15A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**


[PHASE] = L1L2L3 (shown)

Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-IGL515C-IGL515C-IGL515C-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-IGL515C-IGL515C-IGL515C-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 15A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

277V, single-phase / 1 x 1-pole / 1 x L7-15C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-L715C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION



Enclosure views; cord shortened

Supply	277V, single-phase
A Protection	1 x 15A, 1-pole breaker
B Output	1 x L7-15C cord-end connector
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L7-15C

15A, 277V AC device rating
Equipment ground included
Neutral included

Specify when ordering



T225 conductor arrangement

For this **277V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-L715C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-L715C-G-L2-T
Reverse: PT225-C-10-DCXX-L715C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 15A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

277V, single-phase per output / 2 x 1-pole / 2 x L7-15C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L715C-L715C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

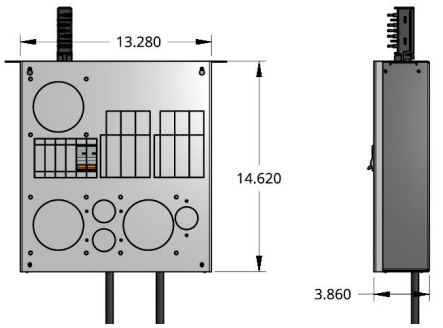

Enclosure views; cord shortened

Supply	277V, single-phase per output
A Protection	2 x 15A, 1-pole breakers; one per output
B Output	2 x L7-15C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L7-15C

15A, 277V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 15A, 1-pole breaker per output.


Cord 1	Cord 2
15A / 1-pole breaker	15A / 1-pole breaker
L1 + N	**L2 + N**

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

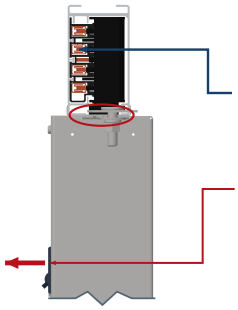


-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors

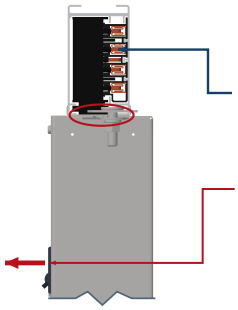

-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L715C-L715C-G-L1L2-T
Reverse: PT225-S-10-DCXX-L715C-L715C-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 15A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

277V, single-phase per output / 3 x 1-pole / 3 x L7-15C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L715C-L715C-L715C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

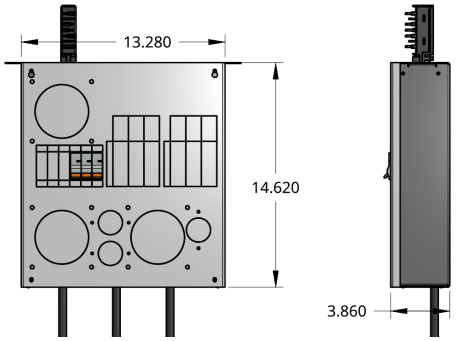

Enclosure views; cord shortened

Supply	277V, single-phase per output
A Protection	3 x 15A, 1-pole breakers; one per output
B Output	3 x L7-15C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L7-15C

15A, 277V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 15A, 1-pole breaker per output.


Cord 1	Cord 2	Cord 3
15A / 1-pole breaker	15A / 1-pole breaker	15A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**

[PHASE] = L1L2L3 (shown)
Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L715C-L715C-L715C-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-L715C-L715C-L715C-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / 1 x 5-20C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-520C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	1 x 5-20C cord-end connector
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



5-20C

20A, 125V AC device rating
Equipment ground included
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-520C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-520C-G-L2-T
Reverse: PT225-C-10-DCXX-520C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / 1 x 5-20C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-IG520C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	1 x 5-20C cord-end connector
Grounding	Isolated ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



5-20C

20A, 125V AC device rating
Isolated equipment ground
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-IG520C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-IG520C-G-L2-T
Reverse: PT225-C-10-DCXX-IG520C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / One cord; duplex 5-20R assembly

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-520D-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	One cord; duplex 5-20R assembly
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



5-20R

20A, 125V AC device rating
Two outlets / one branch
Equipment ground included
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-520D-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-520D-G-L2-T
Reverse: PT225-C-10-DCXX-520D-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop | GFCI

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / One cord; duplex 5-20R assembly

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-520D-G-GFCI-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

trackbusway.com/products/225a-1-pole-breakered-drop-cord

Supply	120V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	One cord; duplex 5-20R assembly
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
GFCI location	At cord-end 5-20R assembly; all outlets protected
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None


B CORD-END OUTPUT



5-20R

20A, 125V AC device rating
Two outlets / one branch
Equipment ground included
GFCI at cord end

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-520D-G-GFCI-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-520D-G-GFCI-L2-T
Reverse: PT225-C-10-DCXX-520D-G-GFCI-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / One cord; duplex 5-20R assembly

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-IG520D-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	One cord; duplex 5-20R assembly
Grounding	Isolated ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



5-20R

20A, 125V AC device rating
Two outlets / one branch
Isolated equipment ground
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-IG520D-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-IG520D-G-L2-T
Reverse: PT225-C-10-DCXX-IG520D-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / One cord; quad 5-20R assembly

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-520Q-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	One cord; quad 5-20R assembly
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



5-20R

20A, 125V AC device rating
Four outlets / one branch
Equipment ground included
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-520Q-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-520Q-G-L2-T
Reverse: PT225-C-10-DCXX-520Q-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™
20A PowerDrop | GFCI

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / One cord; quad 5-20R assembly

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS

PT225-C-10-DCXX-520Q-G-GFCI-[PHASE]-[T/R]


Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION


trackbusway.com/products/225a-1-pole-breakered-drop-cord

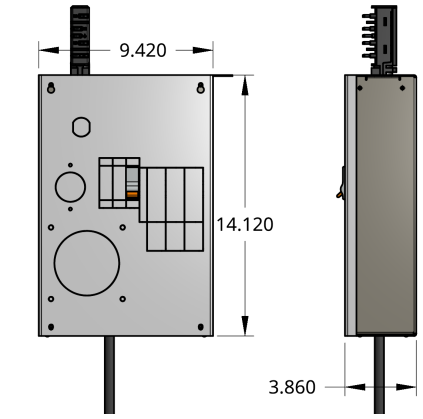

Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	One cord; quad 5-20R assembly
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
GFCI location	At cord-end 5-20R assembly; all outlets protected
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None


B CORD-END OUTPUT



5-20R

20A, 125V AC device rating
Four outlets / one branch
Equipment ground included
GFCI at cord end

Specify when ordering

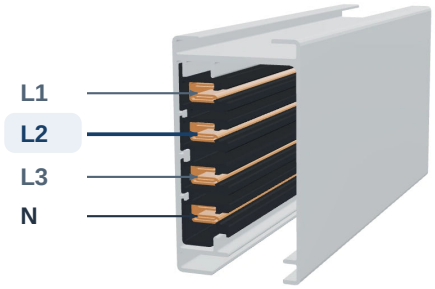

T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-520Q-G-GFCI-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-520Q-G-GFCI-L2-T
Reverse: PT225-C-10-DCXX-520Q-G-GFCI-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / One cord; quad 5-20R assembly

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-IG520Q-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	One cord; quad 5-20R assembly
Grounding	Isolated ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



5-20R

20A, 125V AC device rating
Four outlets / one branch
Isolated equipment ground
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-IG520Q-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-IG520Q-G-L2-T
Reverse: PT225-C-10-DCXX-IG520Q-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / 1 x L5-20C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-L520C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION



Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	1 x L5-20C cord-end connector
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-20C

20A, 125V AC device rating
Equipment ground included
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-L520C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-L520C-G-L2-T
Reverse: PT225-C-10-DCXX-L520C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / 1 x L5-20C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-IGL520C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION



Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	1 x L5-20C cord-end connector
Grounding	Isolated ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-20C

20A, 125V AC device rating
Isolated equipment ground
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-IGL520C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-IGL520C-G-L2-T
Reverse: PT225-C-10-DCXX-IGL520C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 2 x 1-pole / 2 x L5-20C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L520C-L520C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

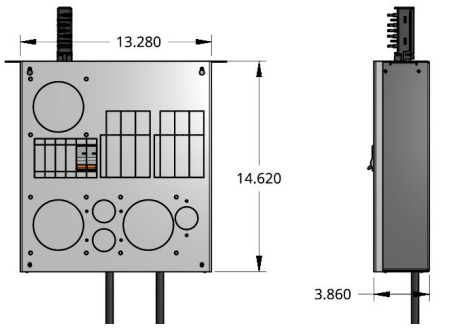

Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	2 x 20A, 1-pole breakers; one per output
B Output	2 x L5-20C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-20C

20A, 125V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 20A, 1-pole breaker per output.


Cord 1	Cord 2
20A / 1-pole breaker	20A / 1-pole breaker
L1 + N	**L2 + N**

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L520C-L520C-G-L1L2-T
Reverse: PT225-S-10-DCXX-L520C-L520C-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 2 x 1-pole / 2 x L5-20C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-IGL520C-IGL520C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

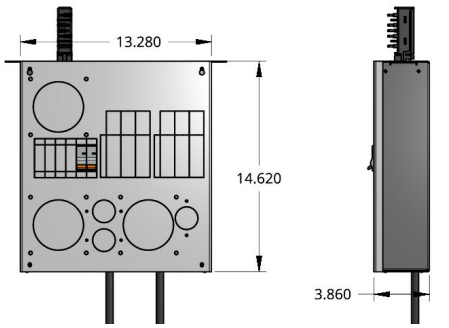

Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	2 x 20A, 1-pole breakers; one per output
B Output	2 x L5-20C cord-end connectors
Grounding	Isolated ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-20C

20A, 125V AC device rating
Isolated equipment ground
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 20A, 1-pole breaker per output.

Cord 1
20A / 1-pole breaker
L1 + N


Cord 2
20A / 1-pole breaker
L2 + N

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-IGL520C-IGL520C-G-L1L2-T
Reverse: PT225-S-10-DCXX-IGL520C-IGL520C-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 3 x 1-pole / 3 x L5-20C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L520C-L520C-L520C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

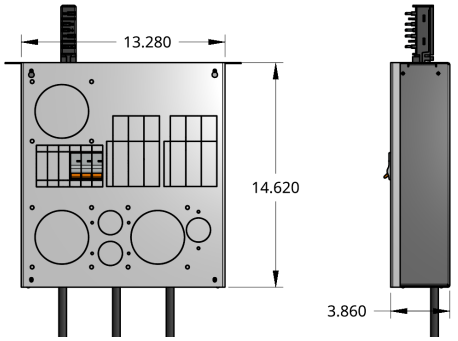

Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	3 x 20A, 1-pole breakers; one per output
B Output	3 x L5-20C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-20C

20A, 125V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 20A, 1-pole breaker per output.


Cord 1	Cord 2	Cord 3
20A / 1-pole breaker	20A / 1-pole breaker	20A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**

[PHASE] = L1L2L3 (shown)
Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L520C-L520C-L520C-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-L520C-L520C-L520C-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 3 x 1-pole / 3 x L5-20C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-IGL520C-IGL520C-IGL520C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

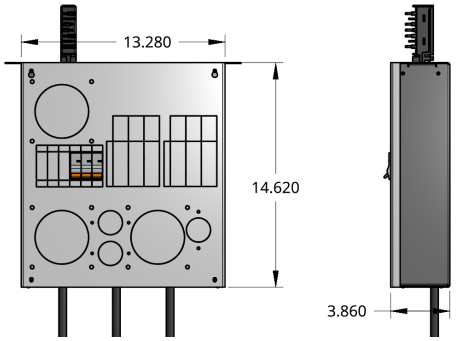

Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	3 x 20A, 1-pole breakers; one per output
B Output	3 x L5-20C cord-end connectors
Grounding	Isolated ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-20C

20A, 125V AC device rating
Isolated equipment ground
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 20A, 1-pole breaker per output.


Cord 1	Cord 2	Cord 3
20A / 1-pole breaker	20A / 1-pole breaker	20A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**

[PHASE] = L1L2L3 (shown)
Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-IGL520C-IGL520C-IGL520C-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-IGL520C-IGL520C-IGL520C-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

240V line-to-neutral; 415Y/240V or 416Y/240V / 1 x 1-pole / 1 x L7-20C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS

PT225-C-10-DCXX-L720C-240LN-1P-G-[PHASE]-[T/R]


Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION


trackbusway.com/products/225a-1-pole-breakered-drop-cord

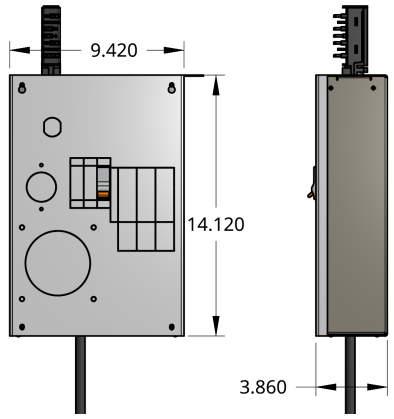

Enclosure views; cord shortened

Supply	240V line-to-neutral; 415Y/240V or 416Y/240V
A Protection	1 x 20A, 1-pole Schneider BGL16020
B Output	1 x L7-20C cord-end connector
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None


B CORD-END OUTPUT



L7-20C

20A, 277V AC device rating
Leviton 2333
Requires L7-20P
Plug: Leviton 2331
Output: 240V L-N

Specify when ordering



T225 conductor arrangement

For this **240V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-L720C-240LN-1P-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-L720C-240LN-1P-G-L2-T
Reverse: PT225-C-10-DCXX-L720C-240LN-1P-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

277V, single-phase / 1 x 1-pole / 1 x L7-20C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-L720C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

Supply	277V, single-phase
A Protection	1 x 20A, 1-pole breaker
B Output	1 x L7-20C cord-end connector
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L7-20C

20A, 277V AC device rating
Equipment ground included
Neutral included

Specify when ordering



T225 conductor arrangement

For this **277V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-L720C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-L720C-G-L2-T
Reverse: PT225-C-10-DCXX-L720C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

240V line-to-neutral; 415Y/240V or 416Y/240V per output / 2 x 1-pole / 2 x L7-20C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS

PT225-S-10-DCXX-L720C-L720C-240LN-1P-G-[PHASE]-[T/R]


Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION


trackbusway.com/products/225a-1-pole-breakered-drop-cord

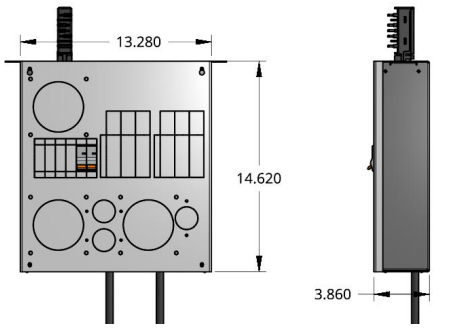

Enclosure views; cord shortened

Supply	240V line-to-neutral; 415Y/240V or 416Y/240V per output
A Protection	2 x 20A, 1-pole Schneider BGL16020
B Output	2 x L7-20C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None


B CORD-END OUTPUT



L7-20C

20A, 277V AC device rating
Leviton 2333
Requires L7-20P
Plug: Leviton 2331
Output: 240V L-N

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 20A, 1-pole breaker per output.


Cord 1	Cord 2
20A / 1-pole breaker	20A / 1-pole breaker
L1 + N	**L2 + N**

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L720C-L720C-240LN-1P-G-L1L2-T
Reverse: PT225-S-10-DCXX-L720C-L720C-240LN-1P-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

277V, single-phase per output / 2 x 1-pole / 2 x L7-20C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L720C-L720C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

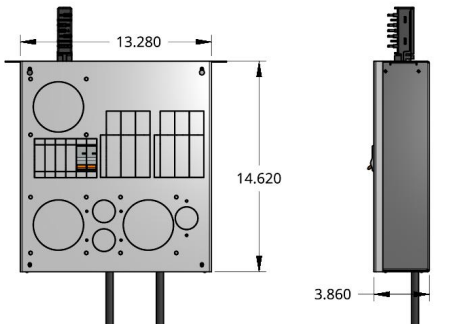


Enclosure views; cord shortened

Supply	277V, single-phase per output
A Protection	2 x 20A, 1-pole breakers; one per output
B Output	2 x L7-20C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L7-20C

20A, 277V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 20A, 1-pole breaker per output.


Cord 1	Cord 2
20A / 1-pole breaker	20A / 1-pole breaker
L1 + N	**L2 + N**

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L720C-L720C-G-L1L2-T
Reverse: PT225-S-10-DCXX-L720C-L720C-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

240V line-to-neutral; 415Y/240V or 416Y/240V per output / 3 x 1-pole / 3 x L7-20C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS

PT225-S-10-DCXX-L720C-L720C-L720C-240LN-1P-G-[PHASE]-[T/R]


Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION


trackbusway.com/products/225a-1-pole-breakered-drop-cord

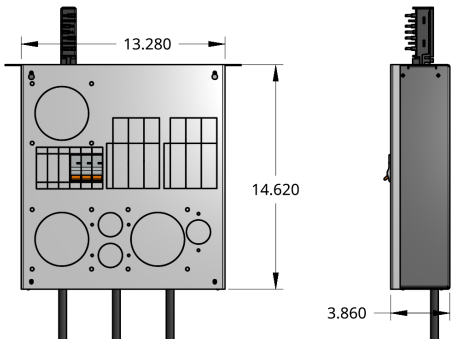

Enclosure views; cord shortened

Supply	240V line-to-neutral; 415Y/240V or 416Y/240V per output
A Protection	3 x 20A, 1-pole Schneider BGL16020
B Output	3 x L7-20C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None


B CORD-END OUTPUT



L7-20C

20A, 277V AC device rating
Leviton 2333
Requires L7-20P
Plug: Leviton 2331
Output: 240V L-N

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 20A, 1-pole breaker per output.

Cord 1	Cord 2	Cord 3
20A / 1-pole breaker	20A / 1-pole breaker	20A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**


[PHASE] = L1L2L3 (shown)

Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L720C-L720C-L720C-240LN-1P-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-L720C-L720C-L720C-240LN-1P-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

277V, single-phase per output / 3 x 1-pole / 3 x L7-20C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L720C-L720C-L720C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

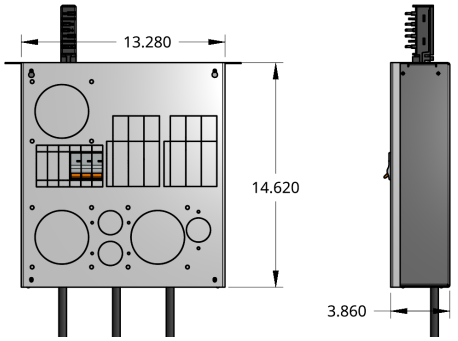


Enclosure views; cord shortened

Supply	277V, single-phase per output
A Protection	3 x 20A, 1-pole breakers; one per output
B Output	3 x L7-20C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L7-20C

20A, 277V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 20A, 1-pole breaker per output.


Cord 1	Cord 2	Cord 3
20A / 1-pole breaker	20A / 1-pole breaker	20A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**

[PHASE] = L1L2L3 (shown)
Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L720C-L720C-L720C-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-L720C-L720C-L720C-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / 1 x L5-30C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-L530C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 30A, 1-pole breaker
B Output	1 x L5-30C cord-end connector
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-30C

30A, 125V AC device rating
Equipment ground included
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-L530C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-L530C-G-L2-T
Reverse: PT225-C-10-DCXX-L530C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / 1 x L5-30C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-IGL530C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

Supply	120V, single-phase
A Protection	1 x 30A, 1-pole breaker
B Output	1 x L5-30C cord-end connector
Grounding	Isolated ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-30C

30A, 125V AC device rating
Isolated equipment ground
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-IGL530C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-IGL530C-G-L2-T
Reverse: PT225-C-10-DCXX-IGL530C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 2 x 1-pole / 2 x L5-30C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L530C-L530C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

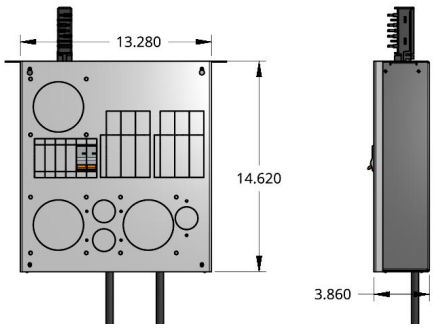


Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	2 x 30A, 1-pole breakers; one per output
B Output	2 x L5-30C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-30C

30A, 125V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 30A, 1-pole breaker per output.

Cord 1
30A / 1-pole breaker
L1 + N


Cord 2
30A / 1-pole breaker
L2 + N

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L530C-L530C-G-L1L2-T
Reverse: PT225-S-10-DCXX-L530C-L530C-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 2 x 1-pole / 2 x L5-30C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-IGL530C-IGL530C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

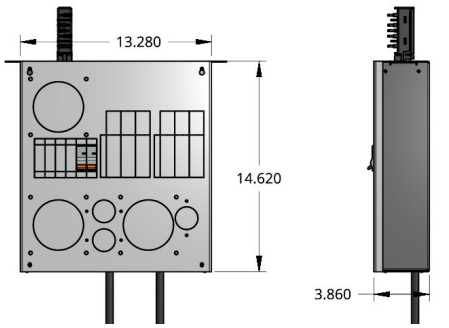


Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	2 x 30A, 1-pole breakers; one per output
B Output	2 x L5-30C cord-end connectors
Grounding	Isolated ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-30C

30A, 125V AC device rating
Isolated equipment ground
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 30A, 1-pole breaker per output.

Cord 1
30A / 1-pole breaker
L1 + N


Cord 2
30A / 1-pole breaker
L2 + N

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-IGL530C-IGL530C-G-L1L2-T
Reverse: PT225-S-10-DCXX-IGL530C-IGL530C-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 3 x 1-pole / 3 x L5-30C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L530C-L530C-L530C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

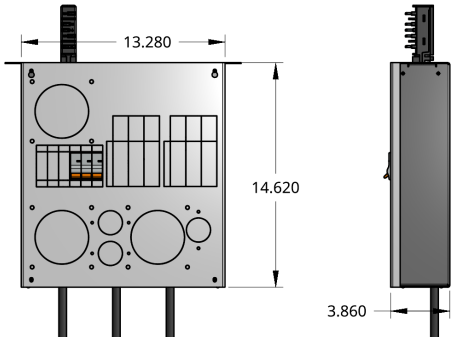


Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	3 x 30A, 1-pole breakers; one per output
B Output	3 x L5-30C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-30C

30A, 125V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 30A, 1-pole breaker per output.


Cord 1	Cord 2	Cord 3
30A / 1-pole breaker	30A / 1-pole breaker	30A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**

[PHASE] = L1L2L3 (shown)
Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L530C-L530C-L530C-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-L530C-L530C-L530C-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase per output / 3 x 1-pole / 3 x L5-30C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-IGL530C-IGL530C-IGL530C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

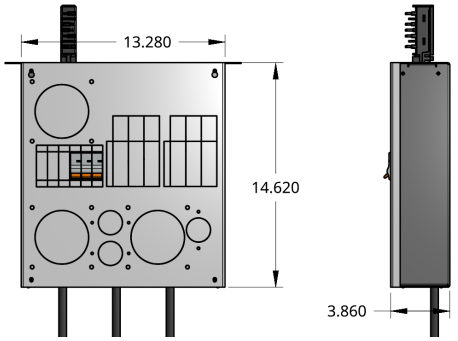


Enclosure views; cord shortened

Supply	120V, single-phase per output
A Protection	3 x 30A, 1-pole breakers; one per output
B Output	3 x L5-30C cord-end connectors
Grounding	Isolated ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L5-30C

30A, 125V AC device rating
Isolated equipment ground
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 30A, 1-pole breaker per output.


Cord 1	Cord 2	Cord 3
30A / 1-pole breaker	30A / 1-pole breaker	30A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**

[PHASE] = L1L2L3 (shown)
Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-IGL530C-IGL530C-IGL530C-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-IGL530C-IGL530C-IGL530C-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

240V line-to-neutral; 415Y/240V or 416Y/240V / 1 x 1-pole / 1 x L7-30C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS

PT225-C-10-DCXX-L730C-240LN-1P-G-[PHASE]-[T/R]


Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION


trackbusway.com/products/225a-1-pole-breakered-drop-cord

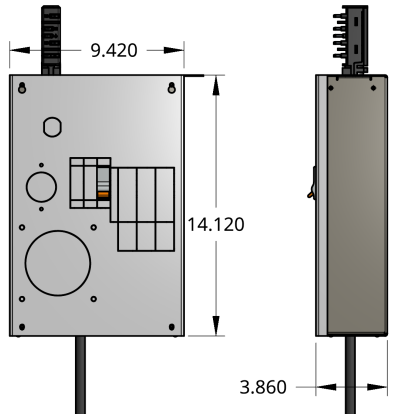

Enclosure views; cord shortened

Supply	240V line-to-neutral; 415Y/240V or 416Y/240V
A Protection	1 x 30A, 1-pole Schneider BGL16030
B Output	1 x L7-30C cord-end connector
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None


B CORD-END OUTPUT



L7-30C

30A, 277V AC device rating
Leviton 2633
Requires L7-30P
Plug: Leviton 2631
Output: 240V L-N

Specify when ordering



T225 conductor arrangement

For this **240V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-L730C-240LN-1P-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-L730C-240LN-1P-G-L2-T
Reverse: PT225-C-10-DCXX-L730C-240LN-1P-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

277V, single-phase / 1 x 1-pole / 1 x L7-30C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-L730C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION




Enclosure views; cord shortened

Supply	277V, single-phase
A Protection	1 x 30A, 1-pole breaker
B Output	1 x L7-30C cord-end connector
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L7-30C

30A, 277V AC device rating
Equipment ground included
Neutral included

Specify when ordering



T225 conductor arrangement

For this **277V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-L730C-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-L730C-G-L2-T
Reverse: PT225-C-10-DCXX-L730C-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

240V line-to-neutral; 415Y/240V or 416Y/240V per output / 2 x 1-pole / 2 x L7-30C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS

PT225-S-10-DCXX-L730C-L730C-240LN-1P-G-[PHASE]-[T/R]


Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION


trackbusway.com/products/225a-1-pole-breakered-drop-cord

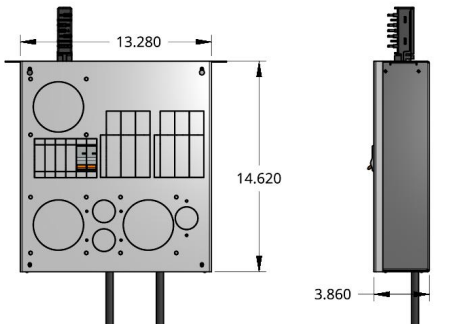

Enclosure views; cord shortened

Supply	240V line-to-neutral; 415Y/240V or 416Y/240V per output
A Protection	2 x 30A, 1-pole Schneider BGL16030
B Output	2 x L7-30C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None


B CORD-END OUTPUT



L7-30C

30A, 277V AC device rating
Leviton 2633
Requires L7-30P
Plug: Leviton 2631
Output: 240V L-N

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 30A, 1-pole breaker per output.

Cord 1
30A / 1-pole breaker
L1 + N


Cord 2
30A / 1-pole breaker
L2 + N

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L730C-L730C-240LN-1P-G-L1L2-T
Reverse: PT225-S-10-DCXX-L730C-L730C-240LN-1P-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

277V, single-phase per output / 2 x 1-pole / 2 x L7-30C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L730C-L730C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

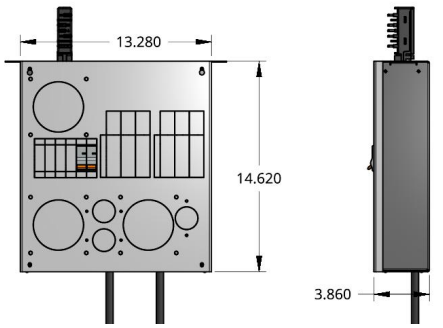


Enclosure views; cord shortened

Supply	277V, single-phase per output
A Protection	2 x 30A, 1-pole breakers; one per output
B Output	2 x L7-30C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L7-30C

30A, 277V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

2 independent circuits; one 30A, 1-pole breaker per output.


Cord 1	Cord 2
30A / 1-pole breaker	30A / 1-pole breaker
L1 + N	**L2 + N**

[PHASE] = L1L2 (shown)
Output order: 1 = L1; 2 = L2. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L730C-L730C-G-L1L2-T
Reverse: PT225-S-10-DCXX-L730C-L730C-G-L1L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

240V line-to-neutral; 415Y/240V or 416Y/240V per output / 3 x 1-pole / 3 x L7-30C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS

PT225-S-10-DCXX-L730C-L730C-L730C-240LN-1P-G-[PHASE]-[T/R]


Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION


trackbusway.com/products/225a-1-pole-breakered-drop-cord

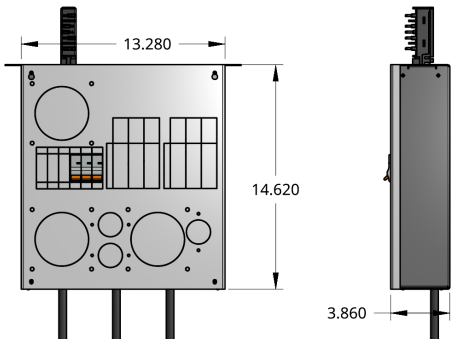

Enclosure views; cord shortened

Supply	240V line-to-neutral; 415Y/240V or 416Y/240V per output
A Protection	3 x 30A, 1-pole Schneider BGL16030
B Output	3 x L7-30C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None


B CORD-END OUTPUT



L7-30C

30A, 277V AC device rating
Leviton 2633
Requires L7-30P
Plug: Leviton 2631
Output: 240V L-N

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 30A, 1-pole breaker per output.

Cord 1	Cord 2	Cord 3
30A / 1-pole breaker	30A / 1-pole breaker	30A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**


[PHASE] = L1L2L3 (shown)

Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L730C-L730C-L730C-240LN-1P-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-L730C-L730C-L730C-240LN-1P-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

277V, single-phase per output / 3 x 1-pole / 3 x L7-30C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-L730C-L730C-L730C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

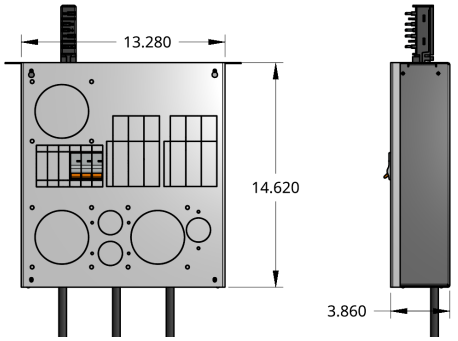


Enclosure views; cord shortened

Supply	277V, single-phase per output
A Protection	3 x 30A, 1-pole breakers; one per output
B Output	3 x L7-30C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



L7-30C

30A, 277V AC device rating
Equipment ground included
Neutral included

Phase connection / specify when ordering



T225 conductor arrangement

3 independent circuits; one 30A, 1-pole breaker per output.


Cord 1	Cord 2	Cord 3
30A / 1-pole breaker	30A / 1-pole breaker	30A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**

[PHASE] = L1L2L3 (shown)
Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L730C-L730C-L730C-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-L730C-L730C-L730C-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™ 50A T225 PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

HBL360C4W | 120V L-N | 1-pole circuit breaker

CATALOGUE NUMBER / FACTORY ORDER SELECTIONS


PT225-C-10-DCXX-360C4W-CB50-G-[PHASE]-[T/R]

Cord length: specify with order; DCXX = length in feet

Standard equipment ground | No power monitoring

YOUR TAP-OFF CONFIGURATION

trackbusway.com/products/225a-1-pole-breakered-drop-cord

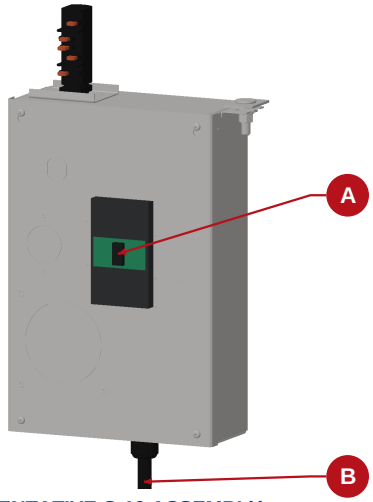

REPRESENTATIVE C-10 ASSEMBLY

GLB enclosure; A/B identify specified components. Illustrative locations; cord shortened. Specify cord length.

SPECIFIED COMPONENTS

A CIRCUIT BREAKER



Schneider BGL16050

50A / 1-pole

B CORD-END CONNECTOR




HBL360C4W

Female output

Assembly rating	50A, 120V L-N
A Circuit breaker	Schneider BGL16050 / 50A, 1-pole
B Output	HBL360C4W / Female cord-end connector
Device rating	60A, 125V; 3 contacts / 4h
Conductors	L + N + G
Matching plug	HBL360P4W (equipment side)
Enclosure	Compact C-10 / 9.420 W x 14.120 H x 3.860 D in.
Required SCCR	Specify with order; factory assembly rating controls

Specify when ordering

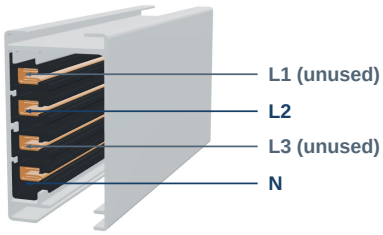

G: bonded housing

PHASE CONNECTION / [PHASE] = L2 (shown)


L2 + N + G

Select L1, L2 or L3. One breaker pole protects the selected line. Neutral connects to the output; it is not a breaker pole. Equipment ground is included.

Ordering example: PT225-C-10-DCXX-360C4W-CB50-G-L2-[T/R]

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

Typical: PT225-C-10-DCXX-360C4W-CB50-G-L2-T
Reverse: PT225-C-10-DCXX-360C4W-CB50-G-L2-R

PT225 family reference: Intertek 5011082; Report 106508638CRT-001. Applicable ETL identification and assembly ratings follow the factory unit label.

Body dimensions exclude projections and cord. Equipment plug supplied with customer equipment.

USA TrackBusway™ 60A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

120V, single-phase / 1 x 1-pole / 1 x 360C4W cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-360C4W-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Select connection below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

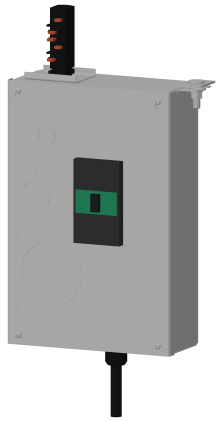


Representative enclosure

Supply	120V, single-phase
A Protection	1 x 60A, 1-pole circuit breaker
B Output	1 x 360C4W cord-end connector
Grounding	Standard equipment ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-1-pole-breakered-drop-cord


B CORD-END OUTPUT



360C4W

60A, 125V AC device rating
3 contacts / 4h
Equipment ground included
Neutral included

Specify when ordering



T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

L1 + N	L2 + N	L3 + N
Alternative	EXAMPLE	Alternative


FILL [PHASE]: L2 (example shown)

PT225-C-10-DCXX-360C4W-G-L2-[T/R]

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-360C4W-G-L2-T
Reverse: PT225-C-10-DCXX-360C4W-G-L2-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.

USA TrackBusway™
100A T225 PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

HBL3100C4W | 120V L-N | 1-pole circuit breaker

CATALOGUE NUMBER / FACTORY ORDER SELECTIONS


PT225-C-10-DCXX-3100C4W-CB100-G-[PHASE]-[T/R]

Cord length: specify with order; DCXX = length in feet

Standard equipment ground | No power monitoring

YOUR TAP-OFF CONFIGURATION

trackbusway.com/products/225a-1-pole-breakered-drop-cord

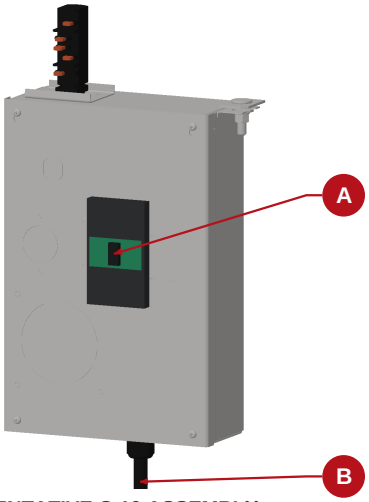

REPRESENTATIVE C-10 ASSEMBLY

GLB enclosure; A/B identify specified components.
Illustrative locations; cord shortened. Specify cord length.

SPECIFIED COMPONENTS

A CIRCUIT BREAKER



Schneider BGL16100

100A / 1-pole

B CORD-END CONNECTOR




HBL3100C4W

Female output

Assembly rating	100A, 120V L-N
A Circuit breaker	Schneider BGL16100 / 100A, 1-pole
B Output	HBL3100C4W / Female cord-end connector
Device rating	100A, 125V; 3 contacts / 4h
Conductors	L + N + G
Matching plug	HBL3100P4W (equipment side)
Enclosure	Compact C-10 / 9.420 W x 14.120 H x 3.860 D in.
Required SCCR	Specify with order; factory assembly rating controls

Specify when ordering

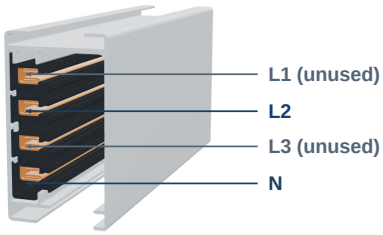

G: bonded housing

PHASE CONNECTION / [PHASE] = L2 (shown)


L2 + N + G

Select L1, L2 or L3. One breaker pole protects the selected line. Neutral connects to the output; it is not a breaker pole. Equipment ground is included.

Ordering example: PT225-C-10-DCXX-3100C4W-CB100-G-L2-[T/R]

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.




-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors



-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

Typical: PT225-C-10-DCXX-3100C4W-CB100-G-L2-T
Reverse: PT225-C-10-DCXX-3100C4W-CB100-G-L2-R

PT225 family reference: Intertek 5011082; Report 106508638CRT-001. Applicable ETL identification and assembly ratings follow the factory unit label.

Body dimensions exclude projections and cord. Equipment plug supplied with customer equipment.