USA TrackBusway™ 50A T225 Outlet Box

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

HBL460R7W | 480V, 3-phase | 3-pole circuit breaker

CATALOGUE NUMBER / FACTORY ORDER SELECTIONS


PT225-C-10-OB-460R7W-CB50-G-[T/R]

One mounted female receptacle

Standard equipment ground | No power monitoring

YOUR TAP-OFF CONFIGURATION

trackbusway.com/products/t225-3-pole-breakered-outlet-box

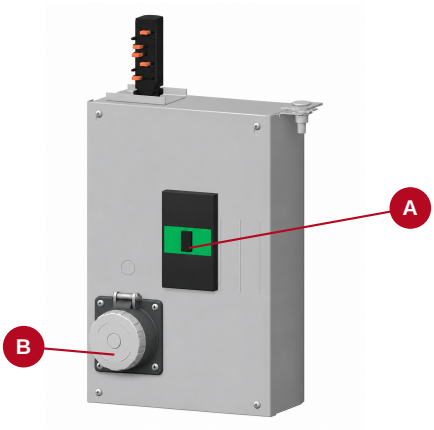

REPRESENTATIVE C-10 ASSEMBLY

Illustrative assembly; device color varies.
A/B identify the specified components.

SPECIFIED COMPONENTS

A CIRCUIT BREAKER



Schneider BGL36050

50A / 3-pole

B MOUNTED RECEPTACLE




HBL460R7W

Female output

Assembly rating	50A, 480V, 3-phase
A Circuit breaker	Schneider BGL36050 / 50A, 3-pole
B Output	HBL460R7W / Mounted female receptacle
Device rating	60A, 480V, 3-phase; 4 contacts / 7h
Conductors	L1 + L2 + L3 + G
Matching plug	HBL460P7W (equipment side)
Enclosure	Compact C-10 / 9.420 W x 14.120 H x 3.860 D in.
Required SCCR	Specify with order; factory assembly rating controls

Specify when ordering

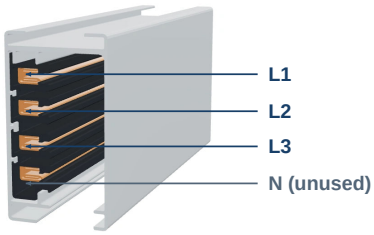

G: bonded housing

PHASE CONNECTION: L1L2L3 (no phase entry)


L1 + L2 + L3 + G

All three phases connect through the 3-pole breaker. Neutral is not connected to this output. Equipment ground is included.

Ordering example: PT225-C-10-OB-460R7W-CB50-G-[T/R]

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

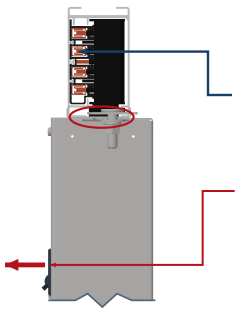


-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors

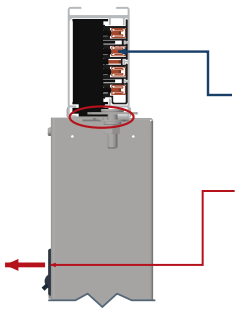

-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

Typical: PT225-C-10-OB-460R7W-CB50-G-T
Reverse: PT225-C-10-OB-460R7W-CB50-G-R

PT225 family reference: Intertek 5011082; Report 106508638CRT-001. Applicable ETL identification and assembly ratings follow the factory unit label.

Body dimensions exclude projections and cord. Equipment plug supplied with customer equipment.