# USA TrackBusway™ 20A 45 ft Cord Reel

**ETL Listed to UL 857 Busway Standards**
by Intertek

**Built in the United States**

120V, single-phase / 1 x 1-pole / One cord; quad 5-20R assembly

## CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


# PT225-C-10-CR45-520Q-G-[PHASE]-[T/R]

**Base configuration**
45 ft retractable cord

**Phase connection**
Select connection below

**Factory orientation**
Choose -T or -R


## YOUR TAP-OFF CONFIGURATION

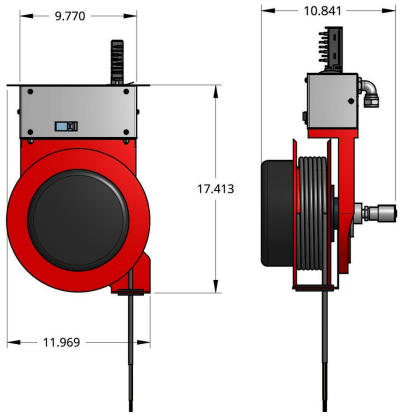


Assembly front + side

| | |
|---|---|
| **Supply** | 120V, single-phase |
| **A Protection** | 1 x 20A, 1-pole breaker |
| **B Output** | One cord; quad 5-20R assembly |
| **Grounding** | Standard equipment ground |
| **Enclosure** | Factory reel / tap assembly |
| **Cord length** | 45 ft retractable |
| **Required SCCR** | Specify with order; subject to factory confirmation |
| **Shared branch** | All outlets share one 20A branch |

**B CORD-END OUTPUT**





**5-20R**

20A, 125V AC device rating
Four outlets / one branch
Equipment ground included
Neutral included

trackbusway.com/products/t225-45ft-breakered-cord-reel

## Specify when ordering

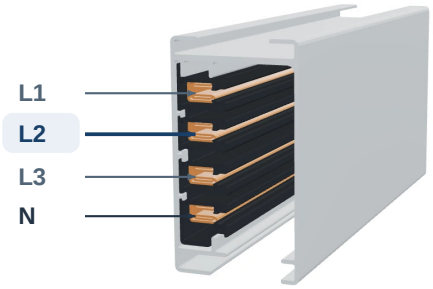


T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

| L1 + N | L2 + N | L3 + N |
|---|---|---|
| Alternative | EXAMPLE | Alternative |


**FILL [PHASE]: L2 (example shown)**

**PT225-C-10-CR45-520Q-G-L2-[T/R]**

**Reel support:** threaded rod larger than 1/4 in. nominal; **1/4-20 not permitted**. Confirm support spacing and clearance.

## CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

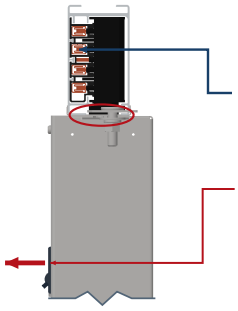


### -T TYPICAL

**CONDUCTORS / INSULATOR**
**LEFT side**

**BREAKER FACES LEFT**

**SAME SIDE**
as the conductors

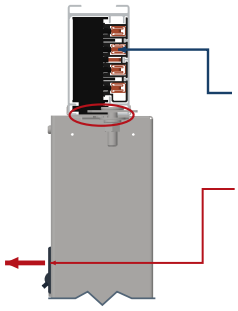

### -R REVERSE

**CONDUCTORS / INSULATOR**
**RIGHT side**

**BREAKER FACES LEFT**

**OPPOSITE SIDE**
as the conductors

**FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.**

**ORDERING EXAMPLES / select connection, orientation and any required cord length**
**Typical: PT225-C-10-CR45-520Q-G-L2-T**
**Reverse: PT225-C-10-CR45-520Q-G-L2-R**

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.