# USA TrackBusway™ 30A PowerDrop

**ETL Listed to UL 857 Busway Standards**
by Intertek

**Built in the United States**

208V, three-phase / 1 x 3-pole / 1 x L15-30C cord-end connector

## CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


# PT225-C-10-DCXX-IGL1530C-G-[T/R]

**Base configuration**
Cord length: specify with order

**Phase connection**
All three phases

**Factory orientation**
Choose -T or -R

## YOUR TAP-OFF CONFIGURATION

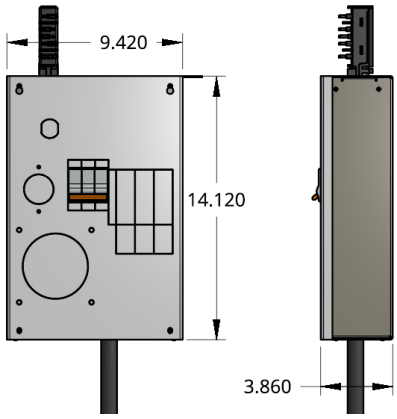



Enclosure views; cord shortened

| | |
|---|---|
| **Supply** | 208V, three-phase |
| **A Protection** | 1 x 30A, 3-pole breaker |
| **B Output** | 1 x L15-30C cord-end connector |
| **Grounding** | Isolated ground |
| **Enclosure** | Compact C |
| **Body W x H x D** | 9.420 x 14.120 x 3.860 in. |
| **Cord length** | Specify with order |
| **Required SCCR** | Specify with order; subject to factory confirmation |
| **Power monitoring** | None |

[trackbusway.com/products/t225-3-pole-breakered-drop-cord](trackbusway.com/products/t225-3-pole-breakered-drop-cord)


**B CORD-END OUTPUT**




**L15-30C**

30A, 250V AC device rating
Isolated equipment ground
No neutral contact

## Specify when ordering

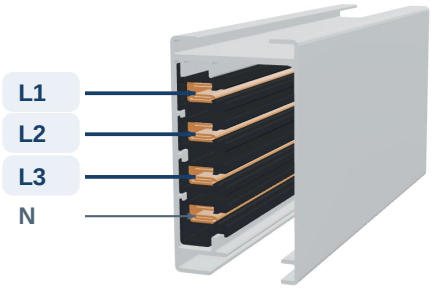


T225 conductor arrangement

This **3-pole** unit uses **L1 + L2 + L3**; **no neutral**.

| L1 | L2 | L3 |
|---|---|---|
| Connected | Connected | Connected |


**FIXED: L1L2L3 / no phase entry required**

**PT225-C-10-DCXX-IGL1530C-G-[T/R]**

All three phases are fixed for this configuration. No phase suffix is added. Equipment ground remains part of the circuit.

## CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

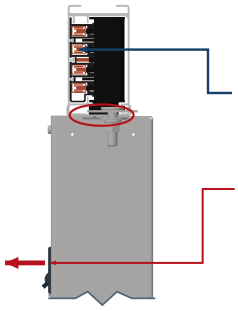


### -T TYPICAL

**CONDUCTORS / INSULATOR**
**LEFT side**

**BREAKER FACES LEFT**

**SAME SIDE**
as the conductors

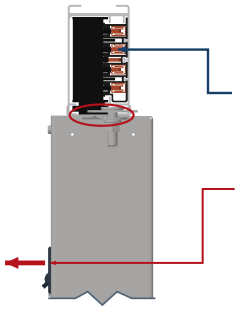

### -R REVERSE

**CONDUCTORS / INSULATOR**
**RIGHT side**

**BREAKER FACES LEFT**

**OPPOSITE SIDE**
as the conductors

**FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.**

**ORDERING EXAMPLES / select connection, orientation and any required cord length**
**Typical: PT225-C-10-DCXX-IGL1530C-G-T**
**Reverse: PT225-C-10-DCXX-IGL1530C-G-R**

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.