USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

208V, three-phase / 1 x 3-pole / 1 x L21-20C cord-end connector

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-C-10-DCXX-IGL2120C-G-[T/R]

Base configuration
Cord length: specify with order

Phase connection
All three phases

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

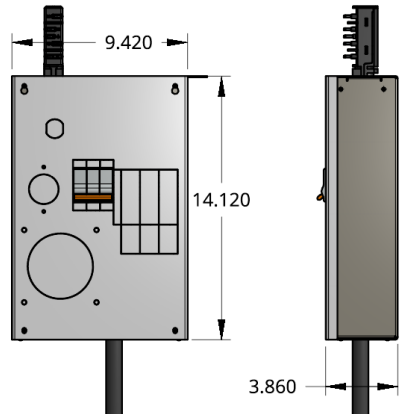

Enclosure views; cord shortened

Supply	208V, three-phase
A Protection	1 x 20A, 3-pole breaker
B Output	1 x L21-20C cord-end connector
Grounding	Isolated ground
Enclosure	Compact C
Body W x H x D	9.420 x 14.120 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/t225-3-pole-breakered-drop-cord


B CORD-END OUTPUT



L21-20C

20A, 120/208V AC device rating
Isolated equipment ground
Neutral included

Specify when ordering

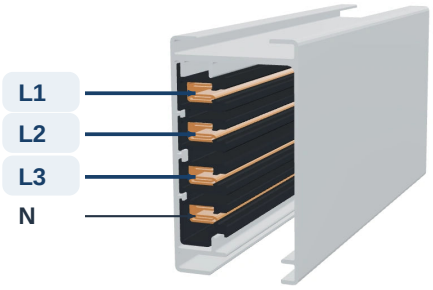

T225 conductor arrangement

This **3-pole** unit uses **L1 + L2 + L3** and **neutral**.

L1	L2	L3
Connected	Connected	Connected


FIXED: L1L2L3 / no phase entry required

PT225-C-10-DCXX-IGL2120C-G-[T/R]

All three phases are fixed for this configuration. No phase suffix is added. Equipment ground remains part of the circuit.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

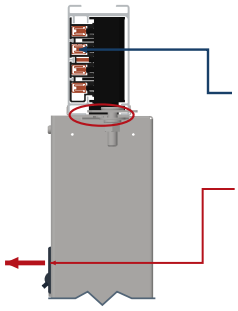


-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors

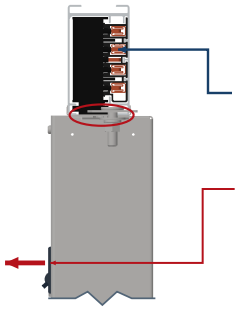

-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING EXAMPLES / select connection, orientation and any required cord length
Typical: PT225-C-10-DCXX-IGL2120C-G-T
Reverse: PT225-C-10-DCXX-IGL2120C-G-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.