USA TrackBusway™ 20A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

208V, single-phase per output / 3 x 2-pole / 3 x L14-20C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-DCXX-IGL1420C-IGL1420C-IGL1420C-G-[PHASE]-[T/R]

Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

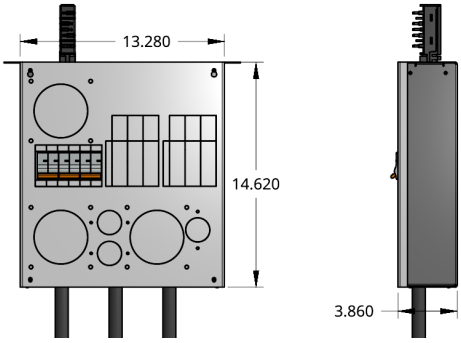

Enclosure views; cord shortened

Supply	208V, single-phase per output
A Protection	3 x 20A, 2-pole breakers; one per output
B Output	3 x L14-20C cord-end connectors
Grounding	Isolated ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-2-pole-breakered-drop-cord


B CORD-END OUTPUT



L14-20C

20A, 125/250V AC device rating
Isolated equipment ground
Neutral included

Phase connection / specify when ordering

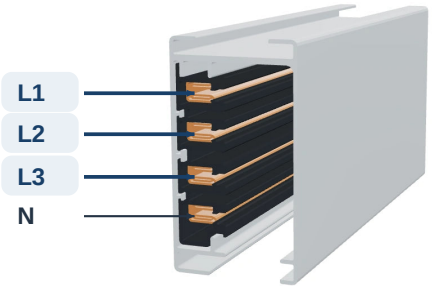

T225 conductor arrangement

3 independent circuits; one 20A, 2-pole breaker per output.


Cord 1	Cord 2	Cord 3
20A / 2-pole breaker	20A / 2-pole breaker	20A / 2-pole breaker
L1 + L2 + N	**L2 + L3 + N**	**L1 + L3 + N**

[PHASE] = L1L2L2L3L1L3 (shown)
Output order: 1 = L1L2; 2 = L2L3; 3 = L1L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

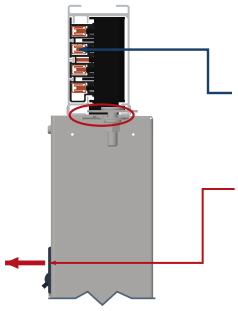


-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors

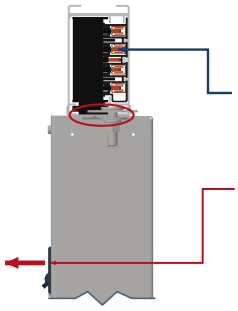

-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-IGL1420C-IGL1420C-IGL1420C-G-L1L2L2L3L1L3-T
Reverse: PT225-S-10-DCXX-IGL1420C-IGL1420C-IGL1420C-G-L1L2L2L3L1L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.