# USA TrackBusway™ 30A PowerDrop

**ETL Listed to UL 857 Busway Standards**
by Intertek

**Built in the United States**

208V, single-phase per output / 3 x 2-pole / 3 x L14-30C cord-end connectors

**CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS**


## PT225-S-10-DCXX-IGL1430C-IGL1430C-IGL1430C-G-[PHASE]-[T/R]

**Base configuration**
Cord length: specify with order

**Phase connection**
Each circuit shown below

**Factory orientation**
Choose -T or -R

## YOUR TAP-OFF CONFIGURATION

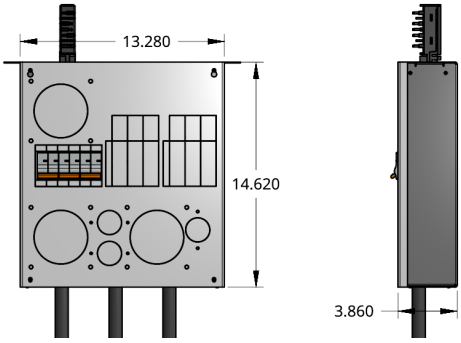


Enclosure views; cord shortened

| | |
|---|---|
| **Supply** | 208V, single-phase per output |
| **A Protection** | 3 x 30A, 2-pole breakers; one per output |
| **B Output** | 3 x L14-30C cord-end connectors |
| **Grounding** | Isolated ground |
| **Enclosure** | Standard S |
| **Body W x H x D** | 13.280 x 14.620 x 3.860 in. |
| **Cord length** | Specify with order |
| **Required SCCR** | Specify with order; subject to factory confirmation |
| **Power monitoring** | None |

[trackbusway.com/products/225a-2-pole-breakered-drop-cord](trackbusway.com/products/225a-2-pole-breakered-drop-cord)


**B CORD-END OUTPUT**




### L14-30C

30A, 125/250V AC device rating
Isolated equipment ground
Neutral included

## Phase connection / specify when ordering

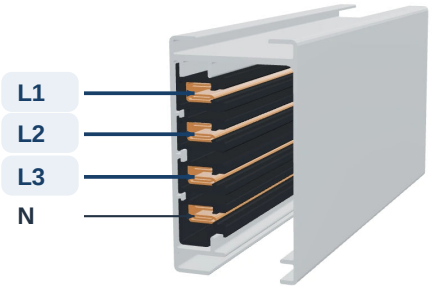


T225 conductor arrangement

**3 independent circuits; one 30A, 2-pole breaker per output.**


| Cord 1 | Cord 2 | Cord 3 |
|---|---|---|
| 30A / 2-pole breaker | 30A / 2-pole breaker | 30A / 2-pole breaker |
| **L1 + L2 + N** | **L2 + L3 + N** | **L1 + L3 + N** |

**[PHASE] = L1L2L2L3L1L3 (shown)**
Output order: 1 = L1L2; 2 = L2L3; 3 = L1L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

## CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

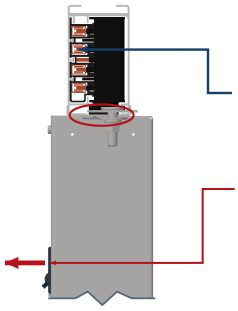


### -T TYPICAL

**CONDUCTORS / INSULATOR**
**LEFT side**

**BREAKER FACES LEFT**

**SAME SIDE**
as the conductors

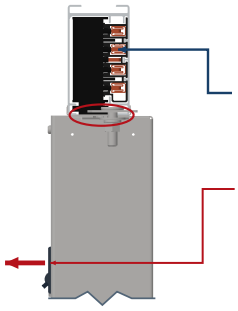

### -R REVERSE

**CONDUCTORS / INSULATOR**
**RIGHT side**

**BREAKER FACES LEFT**

**OPPOSITE SIDE**
as the conductors

**FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.**

**ORDERING FORMAT / specify phase connection, factory orientation and any required cord length**
**Typical: PT225-S-10-DCXX-IGL1430C-IGL1430C-IGL1430C-G-L1L2L2L3L1L3-T**
**Reverse: PT225-S-10-DCXX-IGL1430C-IGL1430C-IGL1430C-G-L1L2L2L3L1L3-R**

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.