USA TrackBusway™ 30A PowerDrop

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

240V line-to-neutral; 415Y/240V or 416Y/240V per output / 3 x 1-pole / 3 x L7-30C cord-end connectors

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS

PT225-S-10-DCXX-L730C-L730C-L730C-240LN-1P-G-[PHASE]-[T/R]


Base configuration
Cord length: specify with order

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION


trackbusway.com/products/225a-1-pole-breakered-drop-cord

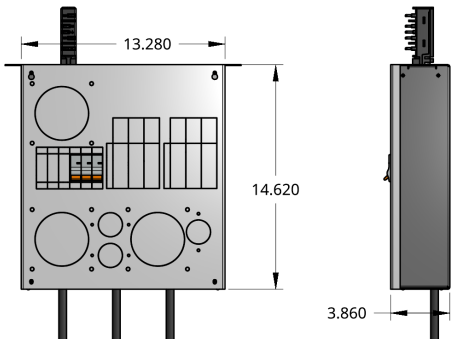

Enclosure views; cord shortened

Supply	240V line-to-neutral; 415Y/240V or 416Y/240V per output
A Protection	3 x 30A, 1-pole Schneider BGL16030
B Output	3 x L7-30C cord-end connectors
Grounding	Standard equipment ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Cord length	Specify with order
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None


B CORD-END OUTPUT



L7-30C

30A, 277V AC device rating
Leviton 2633
Requires L7-30P
Plug: Leviton 2631
Output: 240V L-N

Phase connection / specify when ordering

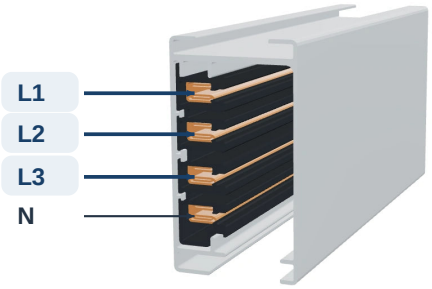

T225 conductor arrangement

3 independent circuits; one 30A, 1-pole breaker per output.

Cord 1	Cord 2	Cord 3
30A / 1-pole breaker	30A / 1-pole breaker	30A / 1-pole breaker
L1 + N	**L2 + N**	**L3 + N**


[PHASE] = L1L2L3 (shown)

Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

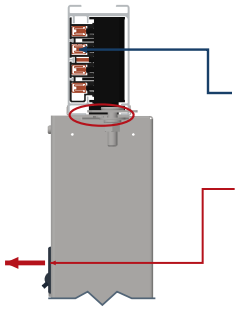


-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors

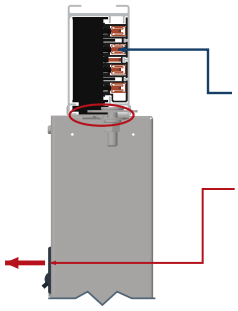

-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-DCXX-L730C-L730C-L730C-240LN-1P-G-L1L2L3-T
Reverse: PT225-S-10-DCXX-L730C-L730C-L730C-240LN-1P-G-L1L2L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.