# USA TrackBusway™ 30A PowerDrop

**ETL Listed to UL 857 Busway Standards**
by Intertek

**Built in the United States**

277V, single-phase per output / 3 x 1-pole / 3 x L7-30C cord-end connectors

**CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS**


## PT225-S-10-DCXX-L730C-L730C-L730C-G-[PHASE]-[T/R]

**Base configuration**
Cord length: specify with order

**Phase connection**
Each circuit shown below

**Factory orientation**
Choose -T or -R

## YOUR TAP-OFF CONFIGURATION

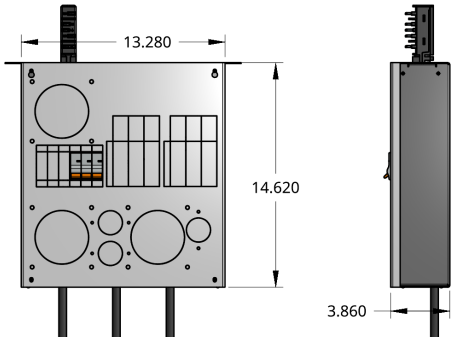



Enclosure views; cord shortened

| | |
|---|---|
| **Supply** | 277V, single-phase per output |
| **A Protection** | 3 x 30A, 1-pole breakers; one per output |
| **B Output** | 3 x L7-30C cord-end connectors |
| **Grounding** | Standard equipment ground |
| **Enclosure** | Standard S |
| **Body W x H x D** | 13.280 x 14.620 x 3.860 in. |
| **Cord length** | Specify with order |
| **Required SCCR** | Specify with order; subject to factory confirmation |
| **Power monitoring** | None |

[trackbusway.com/products/225a-1-pole-breakered-drop-cord](trackbusway.com/products/225a-1-pole-breakered-drop-cord)


**B CORD-END OUTPUT**




**L7-30C**

30A, 277V AC device rating
Equipment ground included
Neutral included

## Phase connection / specify when ordering

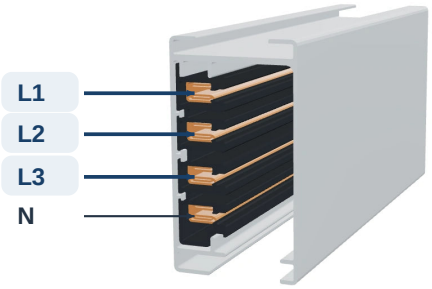


T225 conductor arrangement

**3 independent circuits; one 30A, 1-pole breaker per output.**


| Cord 1 | Cord 2 | Cord 3 |
|---|---|---|
| 30A / 1-pole breaker | 30A / 1-pole breaker | 30A / 1-pole breaker |
| **L1 + N** | **L2 + N** | **L3 + N** |

**[PHASE] = L1L2L3 (shown)**
Output order: 1 = L1; 2 = L2; 3 = L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

## CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

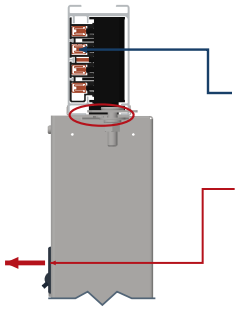


### -T TYPICAL

**CONDUCTORS / INSULATOR**
**LEFT side**

**BREAKER FACES LEFT**

**SAME SIDE**
as the conductors

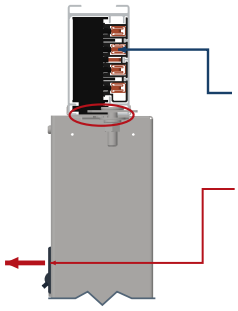

### -R REVERSE

**CONDUCTORS / INSULATOR**
**RIGHT side**

**BREAKER FACES LEFT**

**OPPOSITE SIDE**
as the conductors

**FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.**

**ORDERING FORMAT / specify phase connection, factory orientation and any required cord length**
**Typical: PT225-S-10-DCXX-L730C-L730C-L730C-G-L1L2L3-T**
**Reverse: PT225-S-10-DCXX-L730C-L730C-L730C-G-L1L2L3-R**

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.