# USA TrackBusway™ 20A Outlet Box

**ETL Listed to UL 857 Busway Standards**
by Intertek

**Built in the United States**

120V, single-phase / 1 x 1-pole / Quad 5-20R receptacle assembly

## CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


# PT225-S-10-OB-IG520Q-G-[PHASE]-[T/R]

**Base configuration**
Unit + receptacle shown below

**Phase connection**
Select connection below

**Factory orientation**
Choose -T or -R

## YOUR TAP-OFF CONFIGURATION

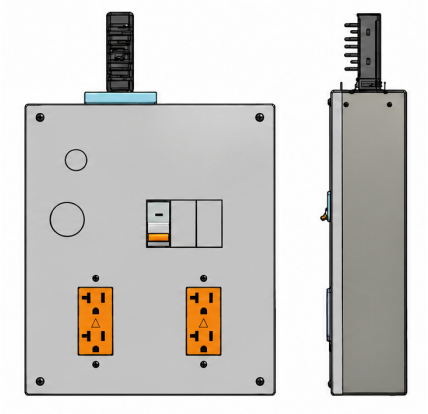


Front + side views

| | |
|---|---|
| **Supply** | 120V, single-phase |
| **A Protection** | 1 x 20A, 1-pole breaker |
| **B Output** | Quad 5-20R receptacle assembly |
| **Grounding** | Isolated ground |
| **Enclosure** | Standard S |
| **Body W x H x D** | 13.280 x 14.620 x 3.860 in. |
| **Required SCCR** | Specify with order; subject to factory confirmation |
| **Power monitoring** | None |

[trackbusway.com/products/225a-1-pole-breakered-outlet-box](trackbusway.com/products/225a-1-pole-breakered-outlet-box)


### B OUTLET RECEPTACLE




**5-20R**

20A, 125V AC device rating
Four outlets / one branch
Isolated equipment ground
Neutral included

## Specify when ordering

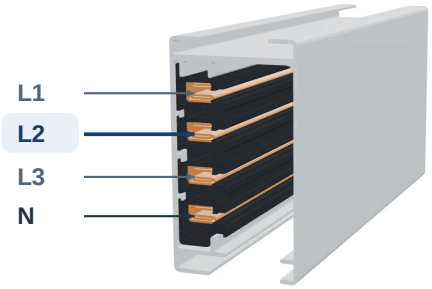


T225 conductor arrangement

For this **120V, 1-pole** configuration, choose **one phase + neutral**.

| L1 + N | L2 + N | L3 + N |
|---|---|---|
| Alternative | EXAMPLE | Alternative |


**FILL [PHASE]: L2 (example shown)**

**PT225-S-10-OB-IG520Q-G-L2-[T/R]**

Highlighted phase connection is an ordering example, not a preset selection. Equipment ground remains part of the circuit.

## CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

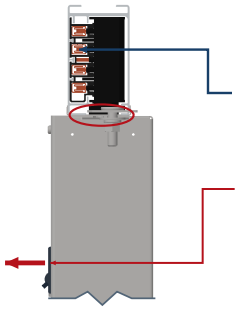


### -T TYPICAL

**CONDUCTORS / INSULATOR**
**LEFT side**

**BREAKER FACES LEFT**

**SAME SIDE**
as the conductors

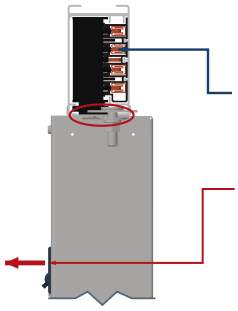

### -R REVERSE

**CONDUCTORS / INSULATOR**
**RIGHT side**

**BREAKER FACES LEFT**

**OPPOSITE SIDE**
as the conductors

**FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.**

**ORDERING EXAMPLES / select connection, orientation and any required cord length**

**Typical: PT225-S-10-OB-IG520Q-G-L2-T**
**Reverse: PT225-S-10-OB-IG520Q-G-L2-R**

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.