USA TrackBusway™ 30A Outlet Box

ETL Listed to UL 857 Busway Standards
by Intertek

Built in the United States

208V, single-phase per output / 3 x 2-pole / 3 x L14-30R receptacles

CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS


PT225-S-10-OB-IGL1430R-IGL1430R-IGL1430R-G-[PHASE]-[T/R]

Base configuration
Unit + receptacle shown below

Phase connection
Each circuit shown below

Factory orientation
Choose -T or -R

YOUR TAP-OFF CONFIGURATION

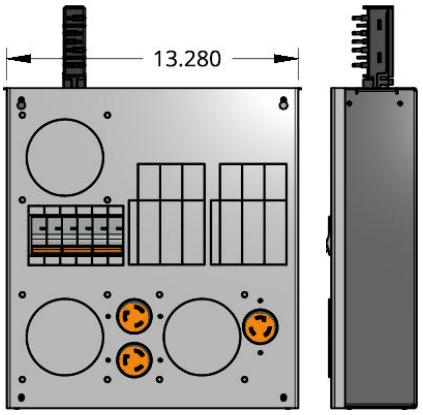

Enclosure views; connection detail at right

Supply	208V, single-phase per output
A Protection	3 x 30A, 2-pole breakers; one per output
B Output	3 x L14-30R receptacles
Grounding	Isolated ground
Enclosure	Standard S
Body W x H x D	13.280 x 14.620 x 3.860 in.
Required SCCR	Specify with order; subject to factory confirmation
Power monitoring	None

trackbusway.com/products/225a-2-pole-breakered-outlet-box


B OUTLET RECEPTACLE



L14-30R

30A, 125/250V AC device rating
Isolated equipment ground
Neutral included

Phase connection / specify when ordering

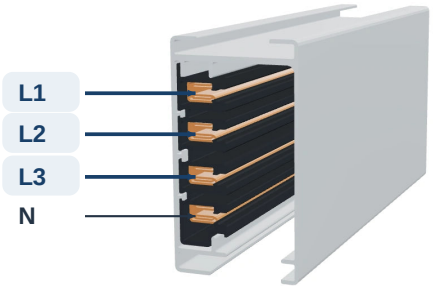

T225 conductor arrangement

3 independent circuits; one 30A, 2-pole breaker per output.


Receptacle 1	Receptacle 2	Receptacle 3
30A / 2-pole breaker	30A / 2-pole breaker	30A / 2-pole breaker
L1 + L2 + N	**L2 + L3 + N**	**L1 + L3 + N**

[PHASE] = L1L2L2L3L1L3 (shown)
Output order: 1 = L1L2; 2 = L2L3; 3 = L1L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

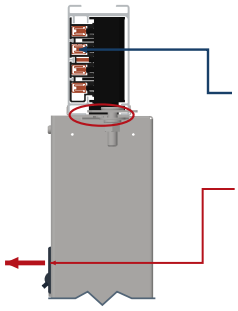


-T TYPICAL

CONDUCTORS / INSULATOR
LEFT side

BREAKER FACES LEFT

SAME SIDE
as the conductors

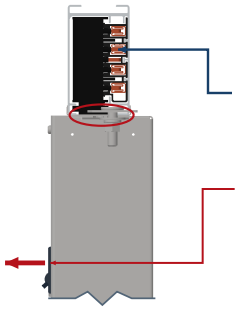

-R REVERSE

CONDUCTORS / INSULATOR
RIGHT side

BREAKER FACES LEFT

OPPOSITE SIDE
as the conductors

FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.

ORDERING FORMAT / specify phase connection, factory orientation and any required cord length
Typical: PT225-S-10-OB-IGL1430R-IGL1430R-IGL1430R-G-L1L2L2L3L1L3-T
Reverse: PT225-S-10-OB-IGL1430R-IGL1430R-IGL1430R-G-L1L2L2L3L1L3-R

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.