# USA TrackBusway™ 20A Outlet Box

**ETL Listed to UL 857 Busway Standards**
by Intertek

**Built in the United States**

208V, single-phase per output / 3 x 2-pole / 3 x L14-20R receptacles

**CATALOGUE NUMBER / FIXED CONFIGURATION + YOUR ORDER SELECTIONS**


## PT225-S-10-OB-L1420R-L1420R-L1420R-G-[PHASE]-[T/R]

**Base configuration**
Unit + receptacle shown below

**Phase connection**
Each circuit shown below

**Factory orientation**
Choose -T or -R

## YOUR TAP-OFF CONFIGURATION

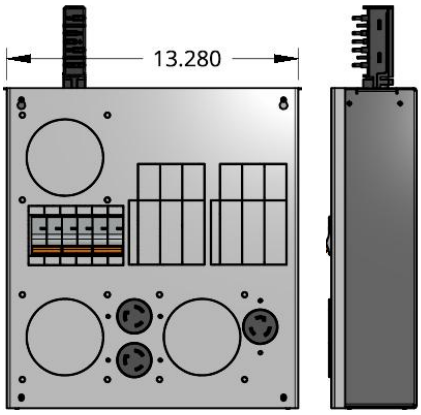


Enclosure views; connection detail at right

| | |
|---|---|
| **Supply** | 208V, single-phase per output |
| **A Protection** | 3 x 20A, 2-pole breakers; one per output |
| **B Output** | 3 x L14-20R receptacles |
| **Grounding** | Standard equipment ground |
| **Enclosure** | Standard S |
| **Body W x H x D** | 13.280 x 14.620 x 3.860 in. |
| **Required SCCR** | Specify with order; subject to factory confirmation |
| **Power monitoring** | None |

trackbusway.com/products/225a-2-pole-breakered-outlet-box


**B OUTLET RECEPTACLE**




### L14-20R

20A, 125/250V AC device rating
Equipment ground included
Neutral included

## Phase connection / specify when ordering

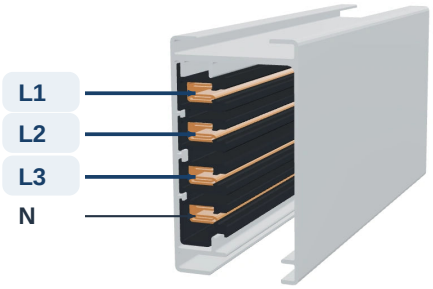


T225 conductor arrangement

**3 independent circuits; one 20A, 2-pole breaker per output.**


| Receptacle 1 | Receptacle 2 | Receptacle 3 |
|---|---|---|
| 20A / 2-pole breaker | 20A / 2-pole breaker | 20A / 2-pole breaker |
| **L1 + L2 + N** | **L2 + L3 + N** | **L1 + L3 + N** |

**[PHASE] = L1L2L2L3L1L3 (shown)**
Output order: 1 = L1L2; 2 = L2L3; 3 = L1L3. N not in code.

Shown circuit assignments are examples, not preset selections. Equipment ground is retained; neutral is included where specified.

## CHOOSE THE FACTORY BREAKER ORIENTATION

Both views below show the breaker facing left. Enclosures continue below the break lines.

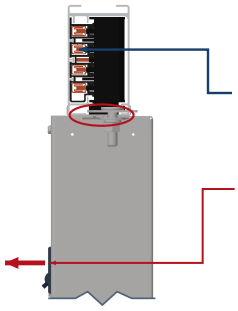


### -T TYPICAL

**CONDUCTORS / INSULATOR**
**LEFT side**

**BREAKER FACES LEFT**

**SAME SIDE**
as the conductors

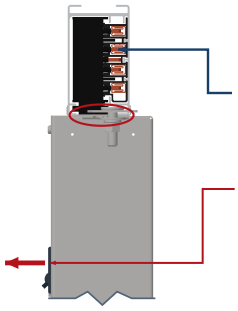

### -R REVERSE

**CONDUCTORS / INSULATOR**
**RIGHT side**

**BREAKER FACES LEFT**

**OPPOSITE SIDE**
as the conductors

**FACTORY-SET. NOT FIELD-ROTATABLE. Select -T or -R when ordering.**

**ORDERING FORMAT / specify phase connection, factory orientation and any required cord length**
**Typical: PT225-S-10-OB-L1420R-L1420R-L1420R-G-L1L2L2L3L1L3-T**
**Reverse: PT225-S-10-OB-L1420R-L1420R-L1420R-G-L1L2L2L3L1L3-R**

Certification reference - covered PT225 factory configurations. Intertek 5011082; Report 106508638CRT-001.

Illustrations not to scale. Body dimensions exclude projections and cord.