T40 wiring & connection details

1pole 120 | Match the rating on the individual cut sheet

Physical phase-access whip



Upper-deck C uses the separately ordered -WP arrangement. The phase-access whip is separate from the equipment output cord.

Electrical paths

Selected phase -> standard 1-pole breaker -> output L


Lower-deck neutral -> output N

Bonded fitting / enclosure -> output ground

Breaker amperage follows the selected cut sheet. Neutral remains separate from equipment ground.


T40 connection reference

Single-circuit PowerDrop | Standard A or B

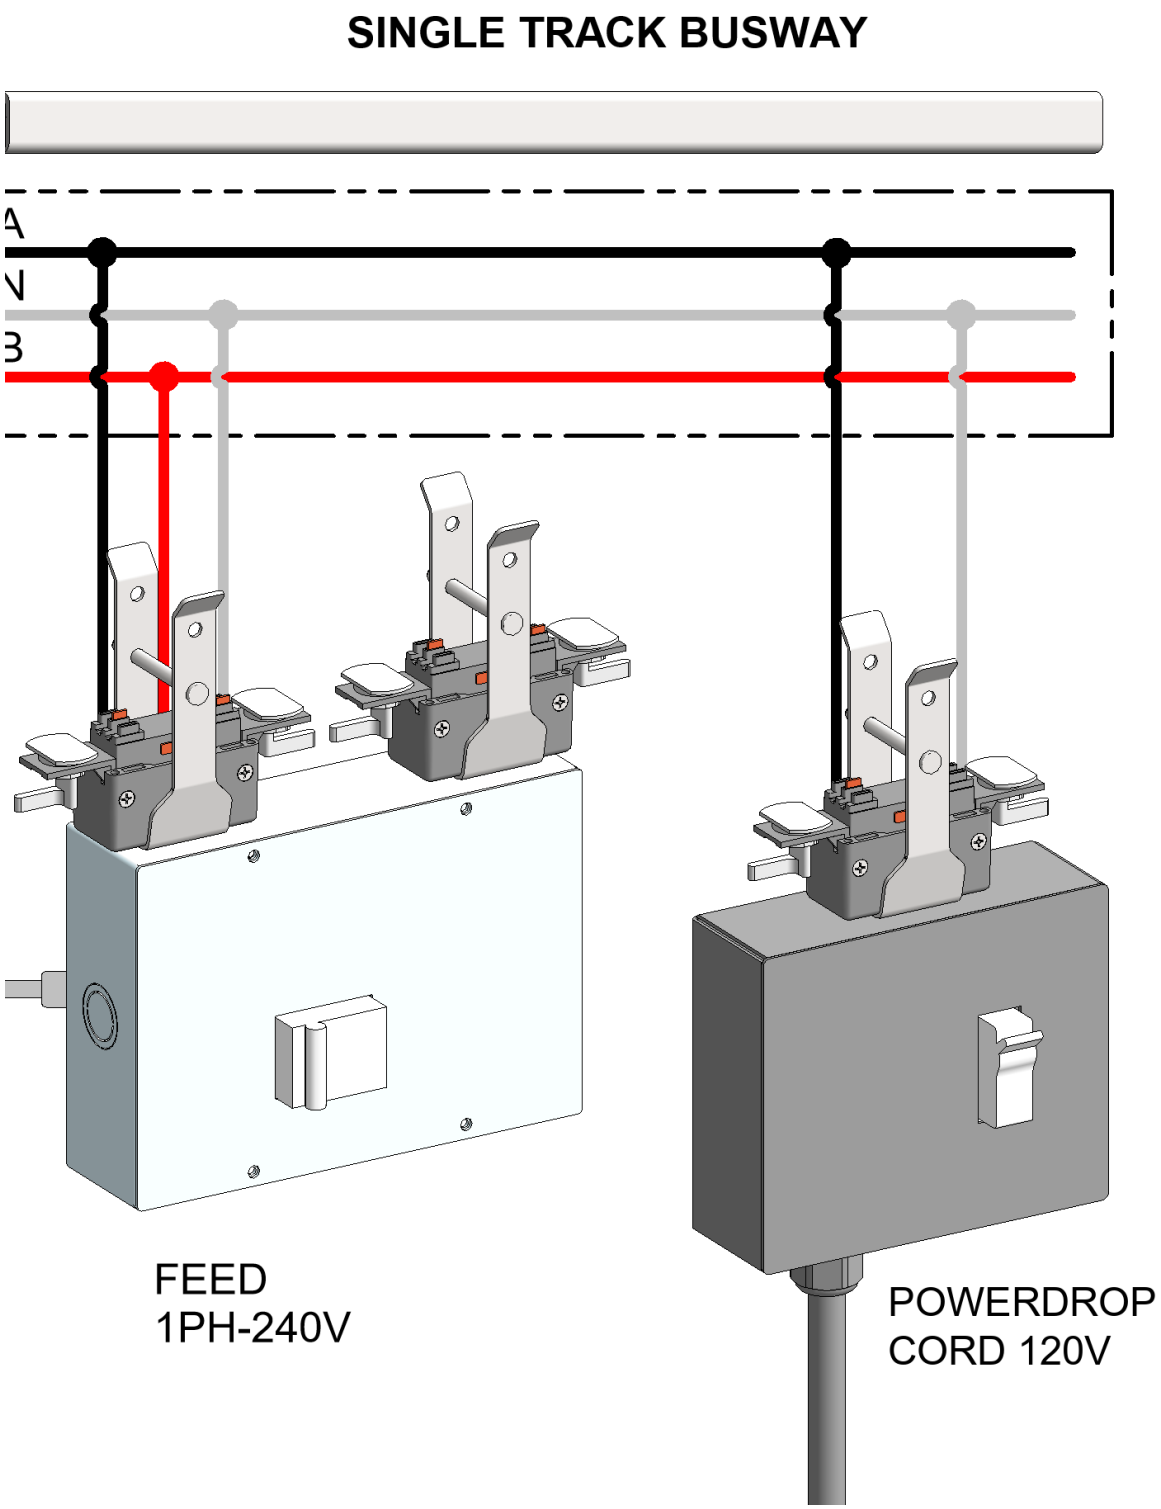


T40 connection reference

Single-circuit PowerDrop | Upper-deck C with -WP

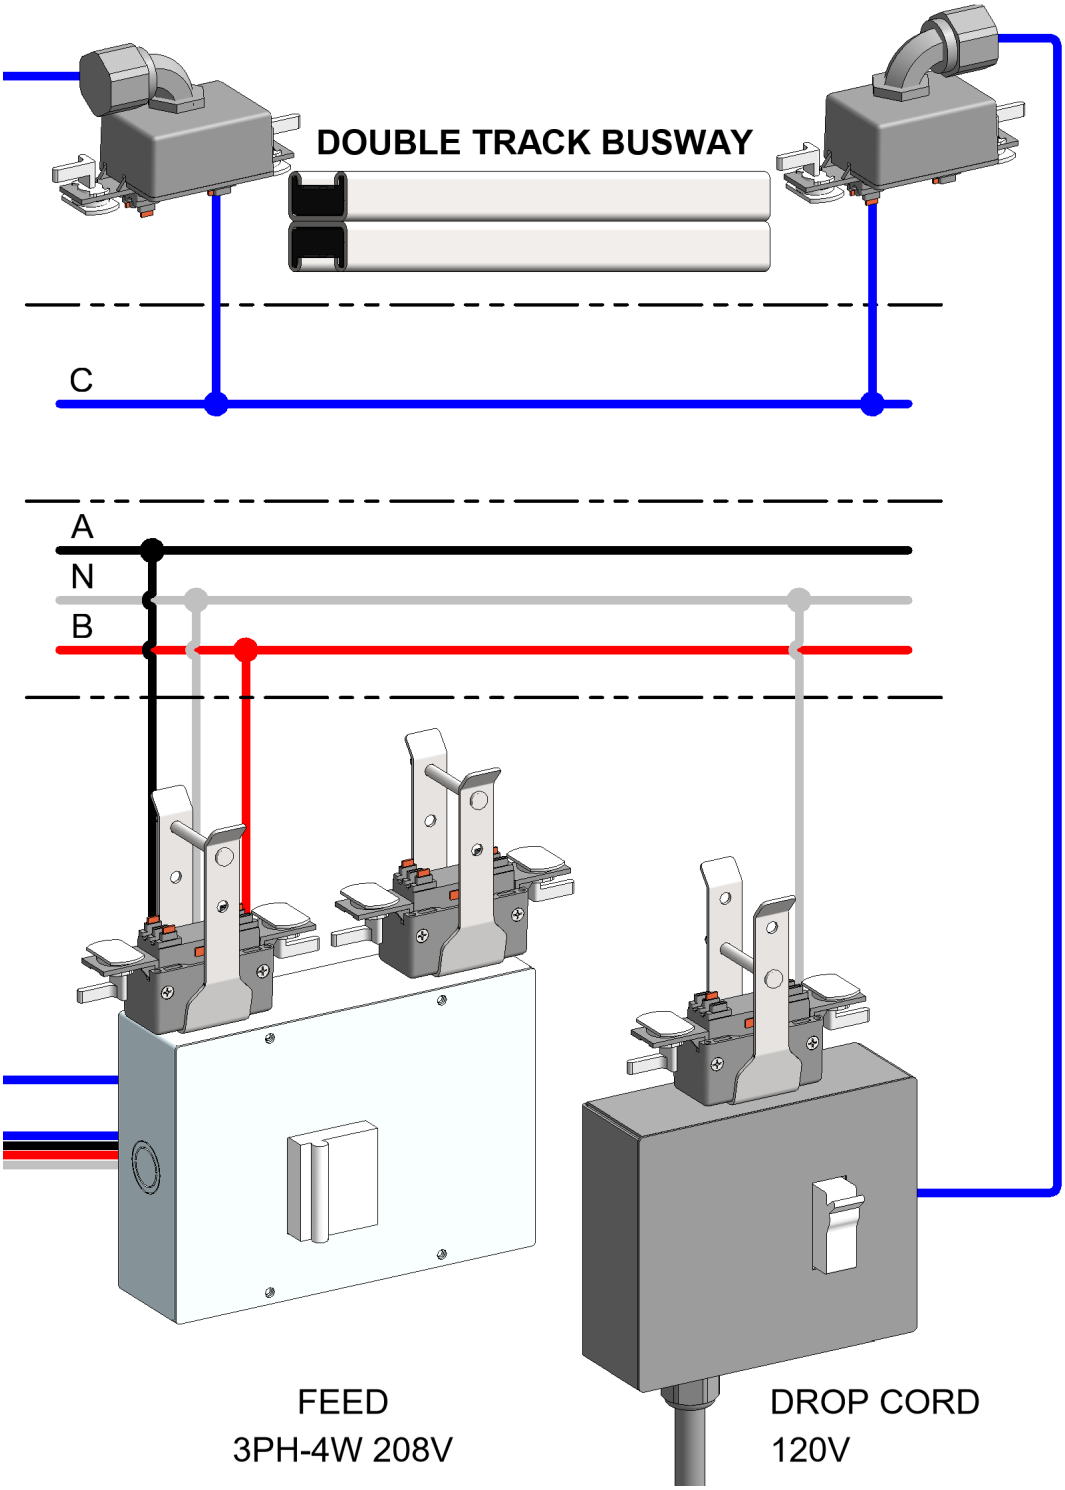

T40 connection reference

Single-circuit outlet box | Standard A or B

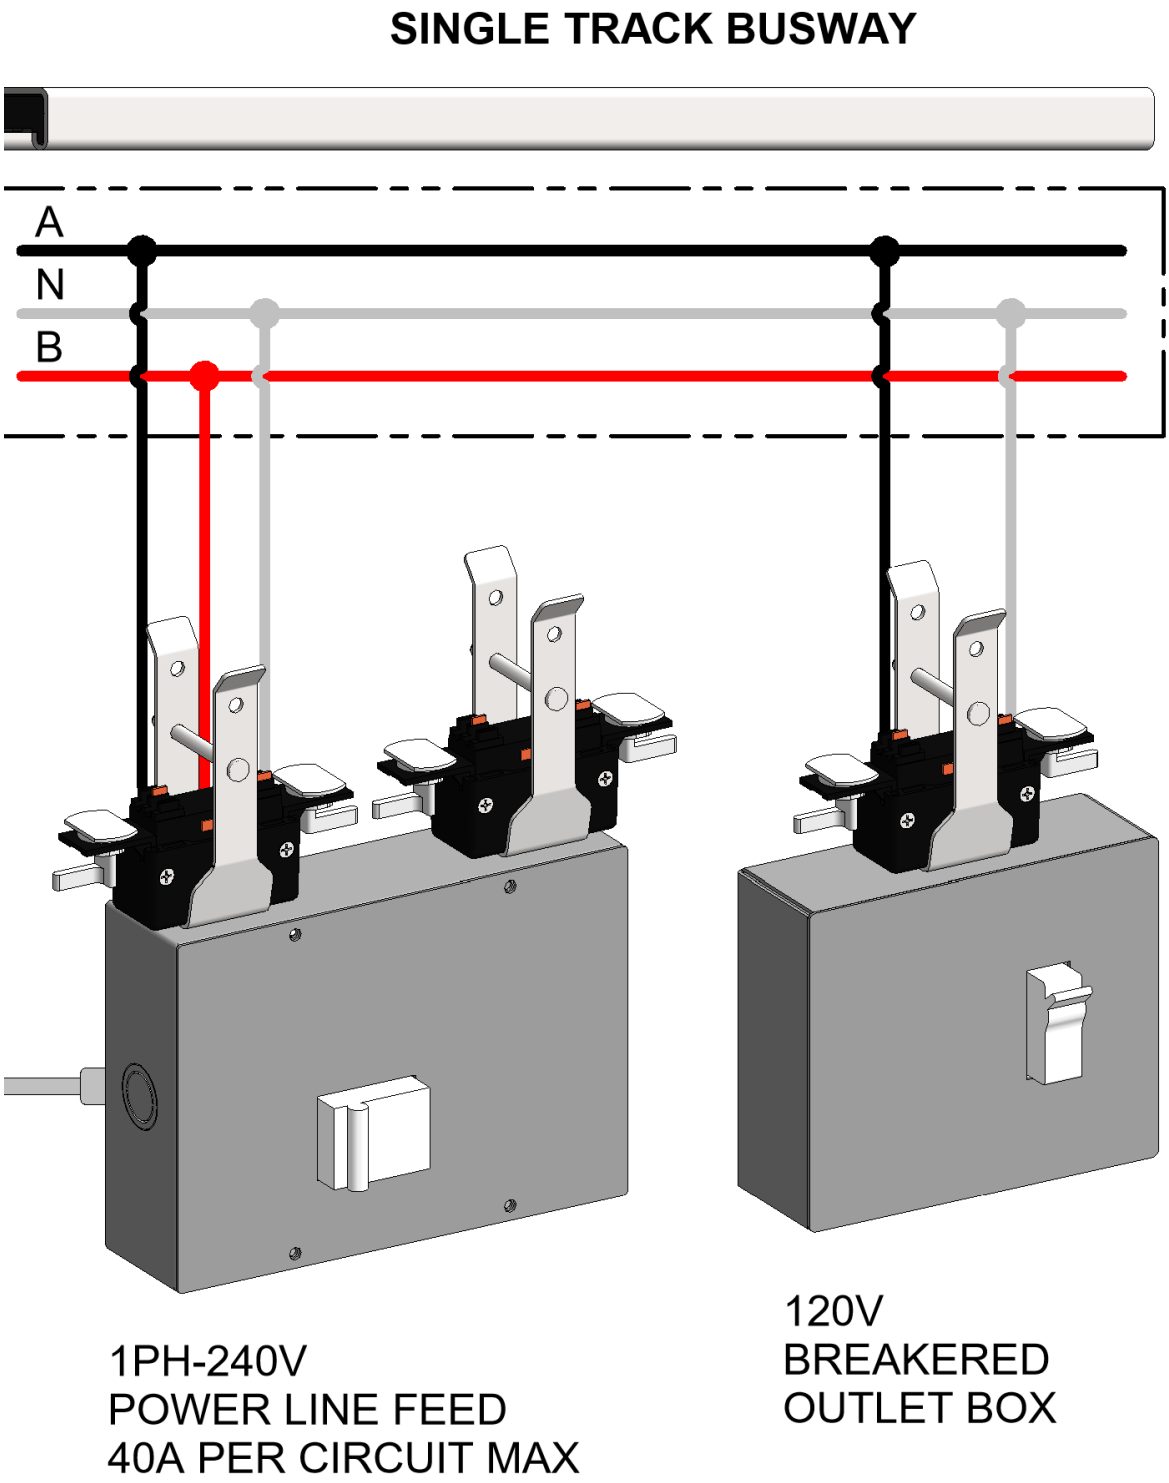

T40 connection reference

Single-circuit outlet box | Upper-deck C with -WP

